

Circulating Fluid Temperature Controller

Thermo-chiller


Standard Type

CE **New**
(Only 400 VAC type) **RoHS**

No heater required, circulating fluid is heated using heat exhausted by refrigerating circuit.

■ Heating-up time: 1/10

HRS150-A-20

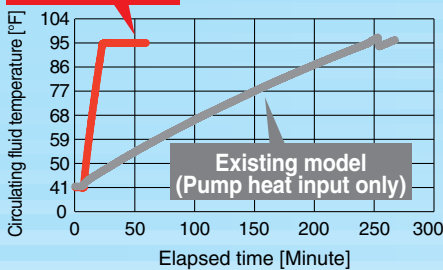


[Test conditions]

Circulating fluid temperature: 41 to 95°F (5 to 35°C)
 Ambient temperature: 90°F (32°C)
 Power supply: 200 VAC/50 Hz
 Circulating fluid flow rate: Rated flow
 Circulating fluid: Water
 External piping: Bypass piping

Cooling valve control

Air-cooled condenser fan

Heating valve control



Cooling capacity **10 kW/15 kW**

Temperature stability **±1.8°C [±1.0°F]**

Set temperature range **41 to 95°F [5°C to 35°C]**

Low-noise design **70 dB(A)**

Max. ambient temperature **113°F [45°C]**

Outdoor installation **IPX4**

Compact, Space-saving



<Air-cooled>



<Water-cooled>

Added Variations!

Option

- With fluid fill port

Optional accessories

- Electric conductivity control set
- Relief valve set
- Snow protection hood (Air-cooled only)

Compatible power supplies in Europe, Asia, Oceania, North, Central and South America



● 3-phase 200 VAC
New ● 3-phase 400 VAC

Series HRS100/150

Environmental friendly
R410A as refrigerant

SMC
CAT.NAS40-62B

Triple controller

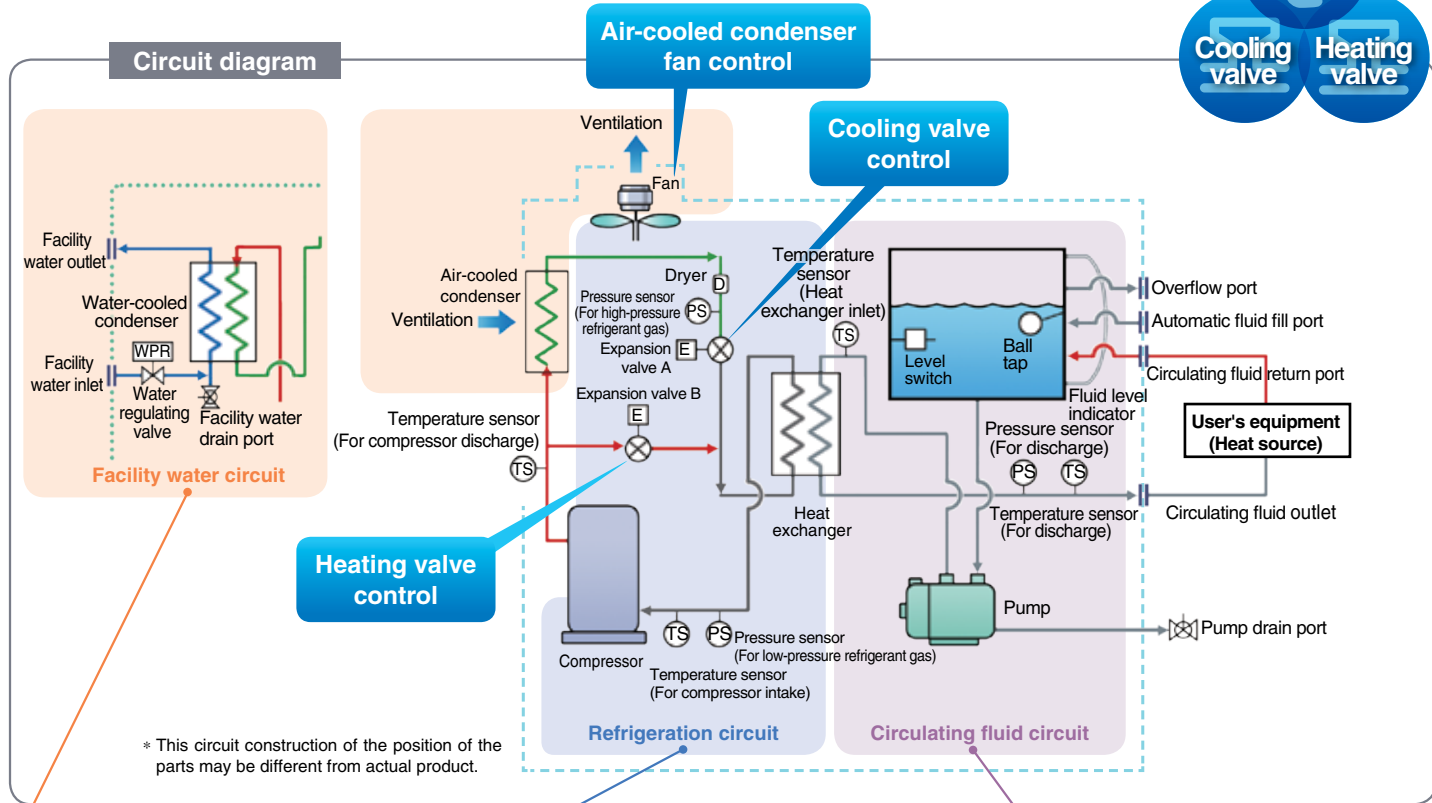

Facility water circuit

For water-cooled refrigeration HRS□-W-□

- The water regulating valve opens and closes to keep the refrigerant gas pressure consistent. The facility water flow rate is controlled by the water regulating valve.

Refrigeration circuit

- The compressor compresses the refrigerant gas, and discharges the high temperature and high pressure refrigerant gas.
- In the case of air-cooled refrigeration, the high temperature and high pressure refrigerant gas is cooled down by an air-cooled condenser with the ventilation of the fan, and becomes a liquid. In the case of water-cooled refrigeration, the refrigerant gas is cooled by a water-cooled condenser with the facility water in the facility water circuit, and becomes a liquid.
- The liquefied high pressure refrigerant gas expands and its temperature lowers when it passes through expansion valve A and vaporizes by taking heat from the circulating fluid in the evaporator.
- The vaporized refrigerant gas is sucked into the compressor and compressed again.
- When heating the circulating fluid, the high pressure and high temperature refrigerant gas is bypassed into the evaporator by expansion valve B, to heat the circulating fluid.

Point

The combination of precise control of **expansion valve A** for cooling, and **expansion valve B** for heating realized high temperature stability.



Circulating fluid circuit

- The circulating fluid discharged from the pump, is heated or cooled by the user's equipment and returns to the thermo-chiller.
- The circulating fluid is controlled to a set temperature by the refrigeration circuit, to be discharged to the user's equipment side again by the thermo-chiller.

Point


Since the refrigeration circuit is controlled by the signal from **2 temperature sensors (for return and discharge)**, precise temperature control of the circulating fluid can be performed. Therefore, there is no necessity of absorbing the temperature difference in the circulating fluid with a large tank capacity, and realizes high temperature stability even with a **small-size tank**. Also, contributes to space-saving.

Variations


Model	Cooling method	Cooling capacity [kW] (50/60 Hz)	Power supply	Option <small>Page 18</small>	Optional accessories <small>Pages 19 to 22</small>
	Air-cooled refrigeration	HRS100	3-phase 200 VAC (50 Hz), 3-phase 200 to 230 VAC (60 Hz) • 3-phase 380 to 415 VAC (50 Hz/60 Hz)	<ul style="list-style-type: none"> • With caster adjuster-foot • With earth leakage breaker (For 400 V type as standard) • With fluid fill port 	<ul style="list-style-type: none"> • Piping conversion fitting • Caster adjuster-foot kit • Electric conductivity control set • Bypass piping set • Relief valve set • Snow protection hood (Air-cooled only)
		HRS150			
	Water-cooled refrigeration	HRS100			
		HRS150			

Circulating fluid can be heated without a heater.

Heating method using discharged heat makes a heater unnecessary.

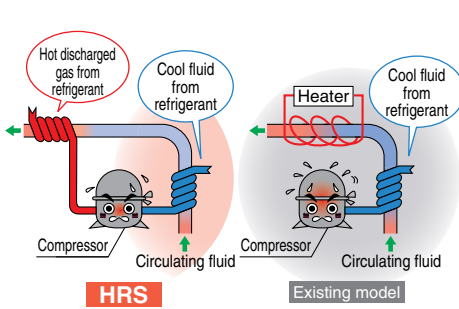


* This is just an example diagram.

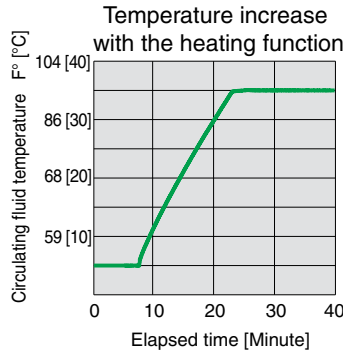

* For HRS150-A-20


- Conditions**
- Circulating fluid temperature: 41 to 95°F (5 to 35°C)
 - Ambient temperature: 90°F (32°C)
 - Power supply: 200 V/50 Hz
 - Circulating fluid flow rate: Rated flow
 - Circulating fluid: Water
 - External piping: Bypass piping

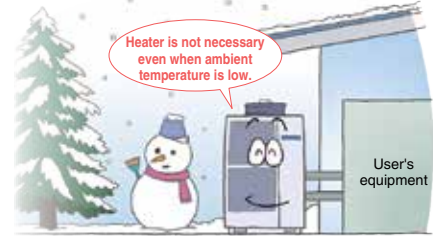

Electric conductivity control set
 (Optional accessories)
 (With DI filter + Solenoid valve kit for control)


The electric conductivity of the circulating fluid can be set with the controller monitor arbitrarily.

Set control range: 5.0 to 45.0 μ S/cm

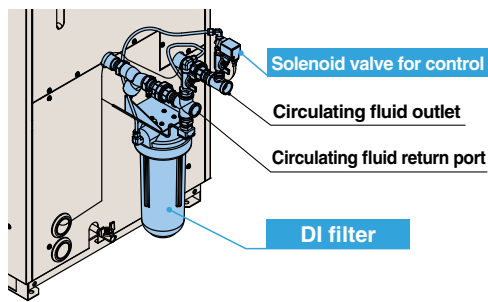


Relief valve set
 (Optional accessories)

Prevents increase in circulating fluid discharge pressure.
 (Relief pressure: 46 psi [0.32 MPa])



With caster adjuster-foot
 (Option)

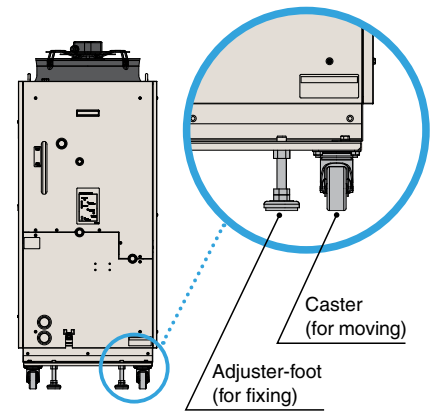

Improved maintenance performance

Circulating fluid fill port (Option)

Fluid fill port is equipped in the upper part of the tank in addition to the automatic fluid fill port for a tap water piping connection.

Front side access


All the electrical components can be checked from the front side for the easier maintenance work.

Alarm code list

Alarm code list stickers (English 1 pc./Japanese 1 pc.) are included.

This can be put under the operation panel for reference.

(Alarm ▶ Page 16)

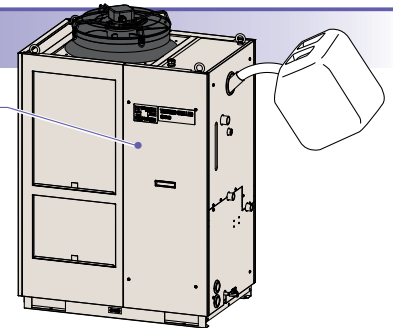


Operation display panel Easy maintenance with the check display

Alarm codes notify of checking times.

Notifies when to check the pump and fan motor. Helpful for facility maintenance.


Ex. AL01 "Low level in tank"

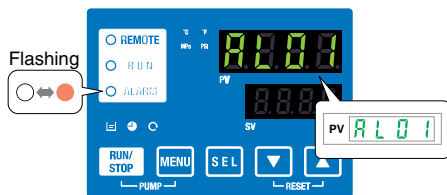

Check display

The internal temperature, pressure and operating time of the product are displayed.

Ex. drv. "Accumulated operating time"

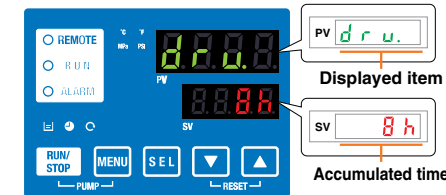

Displayed item	
Temperature	Circulating fluid outlet temperature
	Circulating fluid return temperature
	Compressor gas temperature
Flow rate	Circulating fluid flow rate *1
	Circulating fluid outlet pressure
Pressure	Compressor gas discharge pressure
	Compressor gas return pressure
	Accumulated operating time
Operating time	Accumulated operating time of pump
	Accumulated operating time of fan *2
	Accumulated operating time of compressor
	Accumulated operation time of dustproof filter*2

*1 This is not measurement value. Use it for reference. *2 These are displayed only for air-cooled refrigeration.

Convenient functions Details ▶ Page 16


Timer function, Anti-freezing function, Power failure auto-restart function, Warming-up function, Key-lock function, etc.

Communication function

The serial communication (RS232C/RS485) and contact I/Os (2 inputs and 3 outputs) are equipped as standard. Communication with the user's equipment and system construction are possible, depending on the application. A 24 VDC output can be also provided, and is available for a flow switch (SMC's PF3W, etc.).


Ex.1 Remote signal I/O through serial communication

The remote operation is enabled (to start and stop) through serial communication.

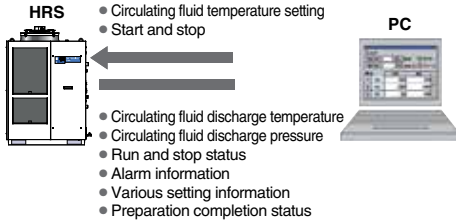

Ex.2 Remote operation signal input


One of the contact inputs is used for remote operation and the other is used for a flow switch to monitor the flow, and their warning outputs are taken in.

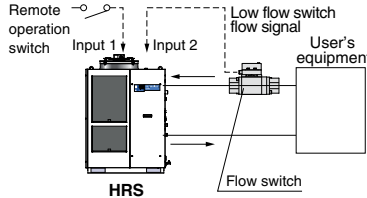

Power for flow switch (24 VDC) can be supplied from the thermo-chiller.

Ex.3 Alarm and operation status (start, stop, etc.) signal output


The alarm and status generated in the product are assigned to 3 output signals based on their contents, and can be output.



• Output setting example

- Output 1: Temperature rise
- Output 2: Pressure rise
- Output 3: Operation status (start, stop, etc.)

Power supply (24 VDC) available

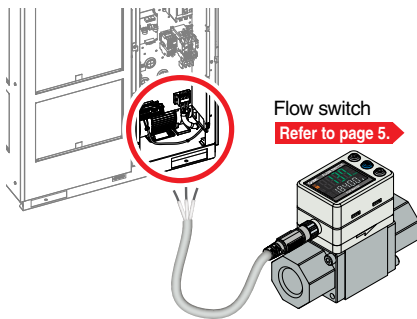

Power can be supplied from the terminal block of the thermo-chiller to external switches etc.

IPX4

IP (International Protection) is the industrial standard for "Degrees of protection provided by outer defensive enclosures of electric equipment (IP Code)" according to IEC 60529 and JIS C 0920.

IPX4: No harmful influence by water splash is acceptable from every direction.


Can be installed outdoors.



Globally compatible power supplies



(Europe, Asia, Oceania, Central and South America) (Only 400 V type)

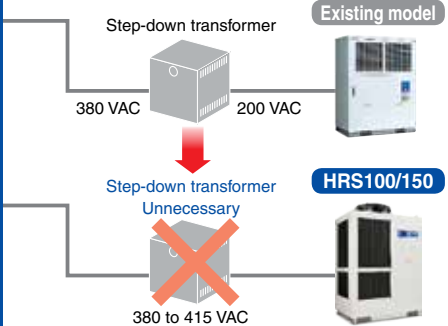

Transformer unnecessary

Power supply Applicable to 200 to 230 VAC, or 380 to 415 VAC

Transformers are unnecessary even when used overseas.

Makes cooling water easily available, anytime, anywhere.

When...

There is no cooling tower.
Tap water is being used.



Even without a cooling tower, an air-cooled refrigerated chiller can be used to easily supply cooling water.



When...


There is a cooling tower, but high temperatures in summer or low (freezing) temperatures in winter make cooling water temperatures unstable.



Cooling water at a consistent temperature can be supplied regardless of the season.



Applications



Laser beam machine/
Laser welding machine

Cooling of the laser oscillation part and power source



Printing machine

Temperature control of the roller



Cleaning machine

Temperature control of cleaning solution



Global Supply Network

SMC has a comprehensive network in the global market.






SMC has a comprehensive network in the global market. We now have a presence of more than 400 branch offices and distributors in 78 countries world wide such as Asia, Oceania, North/Central/South America, and Europe. With this global network, we are able to provide a global supply of our substantial range of products with the best service. We also provide full support to local factories, foreign manufacturing companies and Japanese companies in each country.




SMC Thermo-chiller Variations

Lots of variations are available in response to the users' requirements.

As of November 2014

Series	Temperature stability °F [°C]	Set temperature range °F [°C]	Cooling capacity [kW]											Environment	International standards	
			1.2	1.8	2.4	3	5	6	9	10	15	20	25			
 HRSE Basic type	±3.6 [±2.0]	50 to 86 [10 to 30]	●	●	●										Indoor use	CE (Only 230 VAC type)
 HRS Standard type	±0.18 [±0.1]	41 to 104 [5 to 40]	●	●	●	●	●	●							Indoor use	CE (60 Hz only)
 HRS100/150 Standard type	±1.8 [±1.0]	41 to 95 [5 to 35]								●	●			Outdoor installation IPX4	CE (400 V as standard)	
 HRSH090 Inverter type	±0.18 [±0.1]	41 to 104 [5 to 40]							●					Indoor use	CE UL Standards (To be obtained)	
 HRSH Inverter type	±0.18 [±0.1]	41 to 95 [5 to 35]								●	●	●	●	Outdoor installation IPX4	CE (400 V as standard, 200 V as an option) (200 V only as an option)	

Circulating Fluid/Facility Water Line Equipment

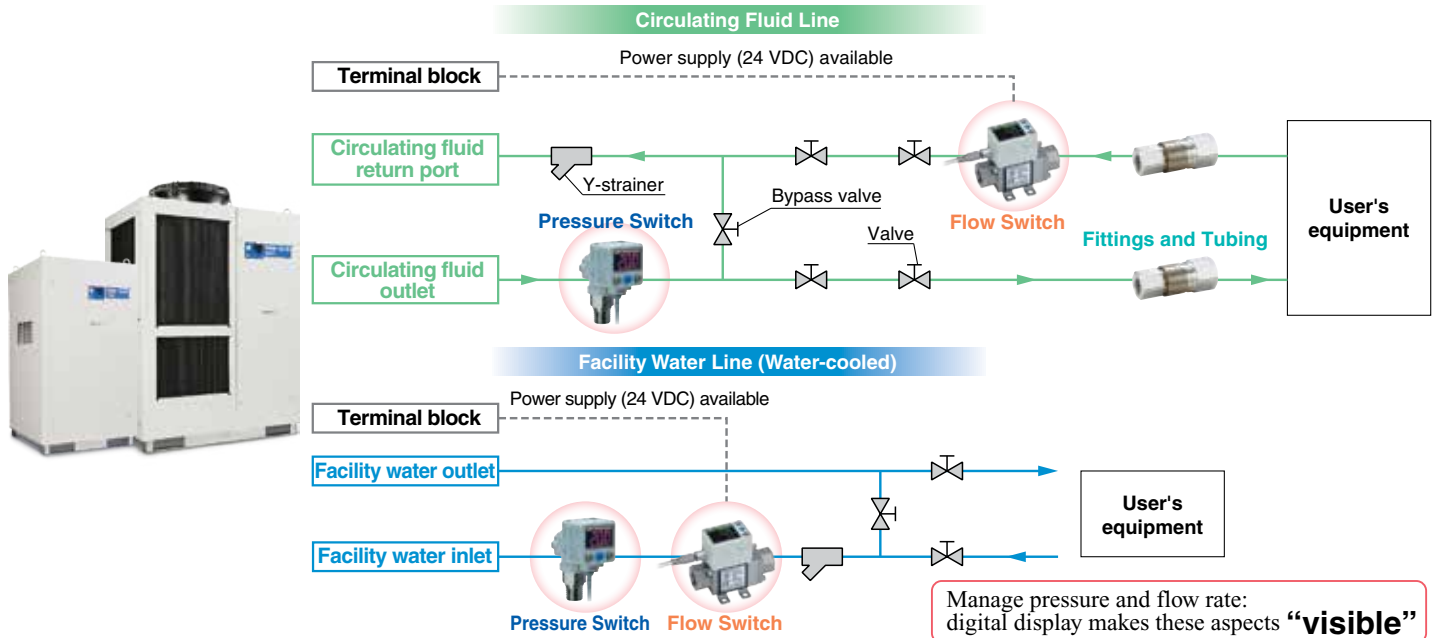

Flow Switch: Monitors the flow rate and temperature of the circulating fluid and facility water. Refer to the WEB catalog or the Best Pneumatics No. 6 for details.

3-Color Display Digital Flow Switch for Water PF3W



Integrated flow adjustment valve and temperature sensor



PVC piping

3-Color Display Electromagnetic Type Digital Flow Switch LFE



Digital Flow Switch for Deionized Water and Chemical Liquids PF2D
4-Channel Flow Monitor PF2□200



Pressure Switch: Monitors pressure of the circulating fluid and facility water. Refer to the WEB catalog or the Best Pneumatics No. 6 for details.



2-Color Display High-Precision Digital Pressure Switch ISE80



Pressure Sensor for General Fluids PSE56□
Pressure Sensor Controller PSE200,300

Fittings and Tubing

Refer to the WEB catalog or the Best Pneumatics No. 6 for details.

S Coupler KK



S Coupler/Stainless Steel (Stainless Steel 304) KKA



Tubing T□



Metal One-touch Fittings KQB2



Stainless Steel 316 One-touch Fittings KQG2



Stainless Steel 316 Insert Fittings KFG2



Fluoropolymer Fittings LQ



Series	Material
T	Nylon
TU	Polyurethane
TH	FEP (Fluoropolymer)
TD	Modified PTFE (Soft fluoropolymer)
TL	Super PFA
TLM	PFA

CONTENTS

Series HRS100/150 **Standard Type**



● Thermo-chiller Series HRS100/150

How to Order/Specifications	Air-cooled 200 V	... Page 7
How to Order/Specifications	Water-cooled 200 V	... Page 8
How to Order/Specifications	Air-cooled 400 V	... Page 9
How to Order/Specifications	Water-cooled 400 V	... Page 10
Cooling Capacity		Page 11
Pump Capacity		Page 12
Dimensions		Page 13
Recommended External Piping Flow		Page 15
Cable Specifications		Page 15
Operation Display Panel		Page 16
List of Function		Page 16
Alarm		Page 16
Communication Function		Page 17

● Options

With Caster Adjuster-Foot	Page 18
With Earth Leakage Breaker	Page 18
With Fluid Fill Port	Page 18

● Optional Accessories

① Piping Conversion Fitting	Page 19
② Caster Adjuster-foot Kit	Page 19
③ Electric Conductivity Control Set	Page 20
④ Bypass Piping Set	Page 20
⑤ Relief Valve Set	Page 21
⑥ Snow Protection Hood	Page 22

● Cooling Capacity Calculation

Required Cooling Capacity Calculation	Page 23
Precautions on Cooling Capacity Calculation	Page 24
Circulating Fluid Typical Physical Property Values	Page 24

Specific Product Precautions	Page 25
------------------------------	---------

Thermo-chiller Standard Type

Air-cooled 200 V Type

Series HRS100/150

RoHS



How to Order

HRS 100 - A - 20 -

Cooling capacity

100	10 kW
150	15 kW

Cooling method

A	Air-cooled refrigeration
---	--------------------------

Pipe thread type

Nil	Rc
F	G (with Rc-G conversion fitting)
N	NPT (with Rc-NPT conversion fitting)

Power supply

20	3-phase 200 VAC (50 Hz) 3-phase 200 to 230 VAC (60 Hz)
----	---

Option

Nil	None
A	With caster adjuster-foot
B	With earth leakage breaker
K (Note)	With fluid fill port

Note) This is a manual fluid fill port that is different from the automatic fluid fill port. Fluid can be supplied manually into the tank without removing the side panel. (Fluid can be supplied manually for models without option -K if the side panel is removed.)

Specifications

Model		HRS100-A□-20-□	HRS150-A□-20-□		
Cooling method		Air-cooled refrigeration			
Refrigerant		R410A (HFC)			
Control method		PID control			
Ambient temperature <small>Note 1)</small>		23 to 113°F (-5 to 45°C)			
Circulating fluid system	Circulating fluid <small>Note 2)</small>	Tap water, 15% Ethylene glycol aqueous solution, Deionized water			
	Set temperature range <small>Note 1)</small>	41 to 95°F (5 to 35°C)			
	Cooling capacity 50/60 Hz <small>Note 3)</small>	kW	9.0/9.5	13.0/14.5	
	Heating capacity 50/60 Hz <small>Note 4)</small>	kW	1.7/2.2	2.5/3.0	
	Temperature stability <small>Note 5)</small>		±1.8 (±1.0)		
	Pump capacity	Rated flow 50/60 Hz (Outlet) <small>Note 6)</small>	11/14.8 gal/min (42/56 L/min)		
		Maximum flow rate 50/60 Hz	14.5 to 17.9 gal/min (55/68 L/min)		
		Maximum pump head	164 ft (50 m)		
	Minimum operating flow rate 50/60 Hz <small>Note 7)</small>		7.4 to 11.0 gal/min (28/42 L/min)		
	Tank capacity		4.75 gal (18 L)		
	Circulating fluid outlet, circulating fluid return port		Rc3/4 (Symbol F: G3/4, Symbol N: NPT3/4)		
	Tank drain port		Rc1/4 (Symbol F: G1/4, Symbol N: NPT1/4)		
	Automatic fluid fill system (Standard)	Supply side pressure range		29 to 73 psi (0.2 to 0.5 MPa)	
		Supply side fluid temperature		41 to 95°F (5 to 35°F)	
Automatic fluid fill port		Rc1/2 (Symbol F: G1/2, Symbol N: NPT1/2)			
Overflow port		Rc1 (Symbol F: G1, Symbol N: NPT1)			
Fluid contact material		Stainless steel, Copper (Heat exchanger brazing), Brass, Bronze, PTFE, PU, EPDM, PVC, NBR, PE, NR, PBT, PP, POM, Carbon, Ceramic			
Electrical system	Power supply		3-phase 200 VAC (50 Hz), 3-phase 200 to 230 VAC (60 Hz) Allowable voltage range ±10% (No continuous voltage fluctuation)		
	Applicable earth leakage breaker <small>Note 8)</small>	Rated current	A	30	40
		Sensitivity of leak current	mA	30	
	Rated operating current 50/60 Hz <small>Note 5)</small>	A	14/15	16/19	
	Rated power consumption 50/60 Hz <small>Note 5)</small>	kW (kVA)	3.8/4.8 (4.9/5.3)	4.7/6.1 (5.6/6.7)	
Noise level (Front 3.3ft [1 m]/Height 3.3 ft [1 m]) <small>Note 5)</small>		dB (A)	70	70	
Waterproof specification		IPX4			
Accessories		Alarm code list stickers 2 pcs. (English 1 pc./Japanese 1 pc.), Operation Manual (for installation/operation) 2 pcs. (English 1 pc./Japanese 1 pc.), Y-strainer 20A 1 pc., Barrel nipple 20A 1 pc., Drain pan for the pump			
Weight (dry state)		377 lbs (171 kg)	390 lbs (177 kg)		

Note 1) Use a 15% ethylene glycol aqueous solution if operating in a place where the ambient temperature and/or circulating fluid temperature is 50°F (10°C) or less.

Note 2) Use fluid in condition below as the circulating fluid.
Tap water: Standard of The Japan Refrigeration And Air Conditioning Industry Association (JRA GL-02-1994)

15% ethylene glycol aqueous solution: diluted by tap water in condition above without any additives such as antiseptics.
Deionized water: Electric conductivity 1 mS/cm or higher (Electric resistivity 1 MW-cm or lower)

Note 3) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Circulating fluid flow rate: Rated flow, ⑤ Power supply: 200 VAC

Note 4) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid flow rate: Rated flow, ④ Power supply: 200 VAC

Note 5) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Load: Same as the cooling capacity, ⑤ Circulating fluid flow rate: Rated flow, ⑥ Power supply: 200 VAC, ⑦ Piping length: Shortest

Note 6) When circulating fluid outlet port pressure – return port pressure = 36 psi (0.25 MPa).
Note 7) Fluid flow rate to maintain the cooling capacity and to keep the circulating fluid discharge pressure to 73 psi (0.5 MPa) or less. If the actual flow rate is lower than this, install a bypass piping.

Note 8) To be prepared by user. A specified earth leakage breaker is installed for option B [With earth leakage breaker].

Note 9) If the product is used at altitude of 3280ft (1000 m) or higher, refer to "Operating Environment/Storage Environment" (page 21) Item 13 ** For altitude of 3280 ft (1000 m) or higher".



Thermo-chiller Standard Type


Water-cooled 200 V Type

Series HRS100/150

RoHS



How to Order

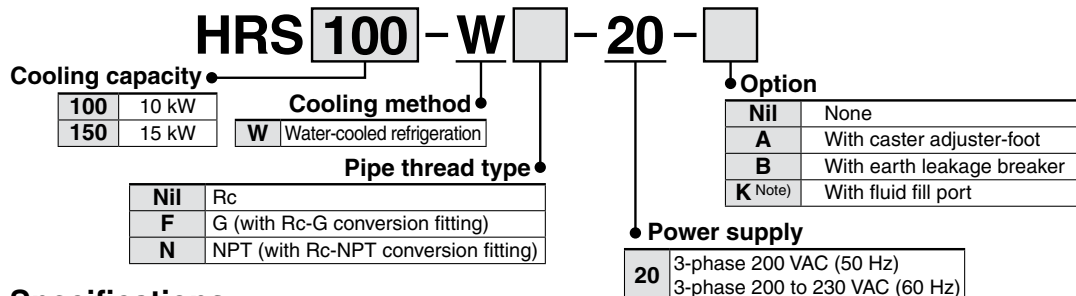

Note) This is a manual fluid fill port that is different from the automatic fluid fill port. Fluid can be supplied manually into the tank without removing the side panel.
(Fluid can be supplied manually for models without option -K if the side panel is removed.)

Specifications

Model		HRS100-W□-20-□	HRS150-W□-20-□
Cooling method		Water-cooled refrigeration	
Refrigerant		R410A (HFC)	
Control method		PID control	
Ambient temperature (Note 1)		36 to 113°F (2 to 45°C)	
Circulating fluid (Note 2)		Tap water, 15% Ethylene glycol aqueous solution, Deionized water	
Set temperature range (Note 1)		41 to 95°F (5 to 35°C)	
Cooling capacity 50/60 Hz (Note 3)		10.0/11.0	14.5/16.5
Heating capacity 50/60 Hz (Note 4)		1.7/2.2	2.5/3.0
Temperature stability (Note 5)		±1.8°F (±1.0°C)	
Circulating fluid system	Pump capacity	11/14.8 gal /min (42/56 L/min)	
	Rated flow 50/60 Hz (Outlet) (Note 6)	14.5 to 17.9 gal/min (55/68 L/min)	
	Maximum flow rate 50/60 Hz	164 ft (50 m)	
	Maximum pump head	7.4/11.0 gal/min (28/42 L/min)	
Minimum operating flow rate 50/60 Hz (Note 7)		4.75 gal (18 L)	
Tank capacity		Rc3/4 (Symbol F: G3/4, Symbol N: NPT3/4)	
Circulating fluid outlet, circulating fluid return port		Rc1/4 (Symbol F: G1/4, Symbol N: NPT1/4)	
Tank drain port		29 to 73 psi (0.2 to 0.5 MPa)	
Automatic fluid fill system (Standard)	Supply side pressure range	41 to 95 °F (5 to 35°C)	
	Supply side fluid temperature	Rc1/2 (Symbol F: G1/2, Symbol N: NPT1/2)	
	Automatic fluid fill port	Rc1 (Symbol F: G1, Symbol N: NPT1)	
Overflow port		Stainless steel, Copper (Heat exchanger brazing), Brass, Bronze, PTFE, PU, EPDM, PVC, NBR, PE, NR, PBT, PP, POM, Carbon, Ceramic	
Fluid contact material		41 to 104°F (5 to 40°C)	
Facility water system	Temperature range	44 to 73 psi (0.3 to 0.5 MPa)	
	Pressure range	8.7/9.0 gal/min (33/34 L/min)	10/10.5 gal/min (38/40 L/min)
	Required flow 50/60 Hz	44 psi (0.3 MPa) or more	
	Facility water pressure differential	Rc3/4	
	Facility water inlet/outlet	Stainless steel, Copper (Heat exchanger brazing), Bronze, Brass PTFE, NBR, EPDM	
Fluid contact material		3-phase 200 VAC (50 Hz), 3-phase 200 to 230 VAC (60 Hz) Allowable voltage range ±10% (No continuous voltage fluctuation)	
Electrical system	Power supply	30	40
	Applicable earth leakage breaker (Note 8)	Sensitivity of leak current mA	
	Rated operating current 50/60 Hz (Note 5)	A	16/19
	Rated power consumption 50/60 Hz (Note 5)	kW	4.6/6.0 (5.6/6.6)
	Noise level (Front 1 m/Height 1 m) (Note 5)	dB (A)	70
Waterproof specification		IPX4	
Accessories		Alarm code list stickers 2 pcs. (English 1 pc./Japanese 1 pc.), Operation Manual (for installation/operation) 2 pcs. (English 1 pc./Japanese 1 pc.), Y-strainer 20A 1 pc., Barrel nipple 20A 1 pc., Drain pan for the pump	
Weight (dry state)		333 lbs (151 Kg)	339 lbs (154 kg)

Note 1) Use a 15% ethylene glycol aqueous solution if operating in a place where the ambient temperature and/or circulating fluid temperature is 50°F (10°C) or less. Also, when there is a possibility of the facility water being frozen, make sure to discharge all the facility water from the facility water circuit.

Note 2) Use fluid in condition below as the circulating fluid. Also, when there is a possibility of the facility water being frozen, make sure to discharge all the facility water from the facility water circuit.

Tap water: Standard of The Japan Refrigeration And Air Conditioning Industry Association (JRA GL-02-1994)
15% ethylene glycol aqueous solution: diluted by tap water in condition above without any additives such as antiseptics.
Deionized water: Electric conductivity 1 mS/cm or higher (Electric resistivity 1 MW·cm or lower)

Note 3) ① Facility water temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Circulating fluid flow rate: Rated flow, ⑤ Power supply: 200 VAC

Note 4) ① Facility water temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid flow rate: Rated flow, ④ Power supply: 200 VAC

Note 5) ① Facility water temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Load: Same as the cooling capacity, ⑤ Circulating fluid flow rate: Rated flow, ⑥ Power supply: 200 VAC, ⑦ Piping length: Shortest

Note 6) When circulating fluid outlet port pressure – return port pressure = 36 psi (0.25 MPa).

Note 7) Fluid flow rate to maintain the cooling capacity and to keep the circulating fluid discharge pressure to 73 psi (0.5 MPa) or less. If the actual flow rate is lower than this, install a bypass piping.

Note 8) To be prepared by user. A specified earth leakage breaker is installed for option B [With earth leakage breaker].

Note 9) If the product is used at altitude of 3280 ft (1000 m) or higher, refer to "Operating Environment/Storage Environment" (page 21) Item 13 ** For altitude of 3280 ft (1000 m) or higher".

Thermo-chiller Standard Type


Air-cooled 400 V Type €

Series HRS100/150

RoHS



How to Order

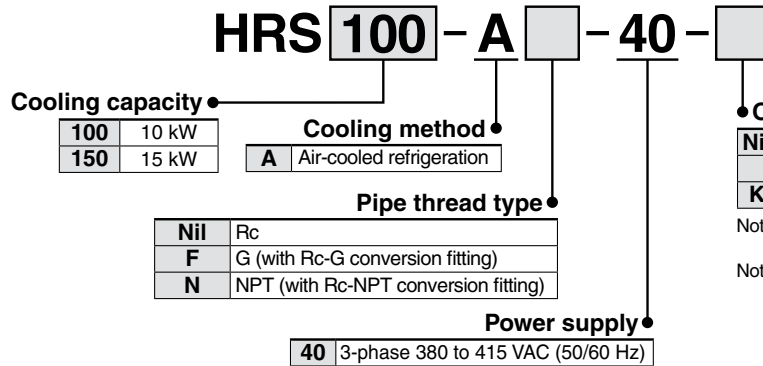

Option

Nil ^{Note 1)}	None
A	With caster adjuster-foot
K ^{Note 2)}	With fluid fill port

Note 1) 400 V type is provided with an earth leakage breaker (-B) as standard.

Note 2) This is a manual fluid fill port that is different from the automatic fluid fill port. Fluid can be supplied manually into the tank without removing the side panel. (Fluid can be supplied manually for models without option -K if the side panel is removed.)

Specifications

Model		HRS100-A□-40-□	HRS150-A□-40-□
Cooling method		Air-cooled refrigeration	
Refrigerant		R410A (HFC)	
Control method		PID control	
Ambient temperature ^{Note 1)}		23 to 113°F (-5 to 45°C)	
Circulating fluid ^{Note 2)}		Tap water, 15% ethylene glycol aqueous solution, Deionized water	
Set temperature range ^{Note 1)}		41 to 95°F (5 to 35°C)	
Cooling capacity 50/60 Hz ^{Note 3)}	kW	9.0/9.5	13.0/14.5
Heating capacity 50/60 Hz ^{Note 4)}	kW	1.7/2.2	2.5/3.0
Temperature stability ^{Note 5)}		±1.8°F (±1.0°C)	
Pump capacity	Rated flow 50/60 Hz (Outlet) ^{Note 6)}	11/14.8 gal/min (42/56 L/min)	
	Maximum flow rate 50/60 Hz	14.5 to 17.9 gal/min (55/68 L/min)	
Maximum pump head		164 ft (50 m)	
Minimum operating flow rate 50/60 Hz ^{Note 7)}		7.4 to 11.0 gal/min (28/42 L/min)	
Tank capacity		4.75 gal (18 L)	
Circulating fluid outlet, circulating fluid return port		Rc3/4 (Symbol F: G3/4, Symbol N: NPT3/4)	
Pump drain port		Rc1/4 (Symbol F: G1/4, Symbol N: NPT1/4)	
Automatic fluid fill system (Standard)	Supply side pressure range	29 to 73 psi (0.2 to 0.5 MPa)	
	Supply side fluid temperature	41 to 95°F (5 to 35°F)	
	Automatic fluid fill port	Rc1/2 (Symbol F: G1/2, Symbol N: NPT1/2)	
Overflow port		Rc1 (Symbol F: G1, Symbol N: NPT1)	
Fluid contact material		Stainless steel, Copper (Heat exchanger brazing), Brass, Bronze, PTFE, PU, EPDM, PVC, NBR, PE, NR, PBT, PP, POM, Carbon, Ceramic	
Power supply		3-phase 380 to 415 VAC (50/60 Hz) Allowable voltage range ±10% (No continuous voltage fluctuation)	
Electrical system	Earth leakage breaker (Standard/With handle)	Rated current A	20
		Sensitivity of leak current mA	30
	Rated operating current 50/60 Hz ^{Note 5)}	A	6.9/7.5
	Rated power consumption 50/60 Hz ^{Note 5)}	kW	3.7/4.7 (4.7/5.3)
			4.8/6.1 (5.7/6.6)
Noise level (Front 1 m/Height 1 m) ^{Note 5)}		dB (A)	70
			72
Waterproof specification		IPX4	
Accessories		Alarm code list stickers 2 pcs. (English 1 pc./Japanese 1 pc.), Operation Manual (for installation/operation) 2 pcs. (English 1 pc./Japanese 1 pc.), Y-strainer 20A 1 pc., Barrel nipple 20A 1 pc., Drain pan for the pump 1 pc.	
Weight (dry state)		377 lbs (171 kg)	390 lbs (177 kg)
Compliant standards	CE marking	EMC Directive	2004/108/EC
		Machinery Directive	2006/42/EC

Note 1) Use a 15% ethylene glycol aqueous solution if operating in a place where the ambient temperature and/or circulating fluid temperature is 50°F (10°C) or less.

Note 2) Use fluid in condition below as the circulating fluid.
Tap water: Standard of The Japan Refrigeration And Air Conditioning Industry Association (JRA GL-02-1994)
15% ethylene glycol aqueous solution: diluted by tap water in condition above without any additives such as antiseptics.
Deionized water: Electric conductivity 1 mS/cm or higher (Electric resistivity 1 MW-cm or lower)

Note 3) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Circulating fluid flow rate: Rated flow, ⑤ Power supply: 200 VAC

Note 4) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid flow rate: Rated flow, ④ Power supply: 200 VAC

Note 5) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Load: Same as the cooling capacity, ⑤ Circulating fluid flow rate: Rated flow, ⑥ Power supply: 200 VAC, ⑦ Piping length: Shortest

Note 6) When circulating fluid outlet port pressure - return port pressure = 36 psi (0.25 MPa).
Note 7) Fluid flow rate to maintain the cooling capacity and to keep the circulating fluid discharge pressure to 73 psi (0.5 MPa) or less. If the actual flow rate is lower than this, install a bypass piping.


Thermo-chiller Standard Type

Water-cooled 400 V Type

Series HRS100/150



How to Order

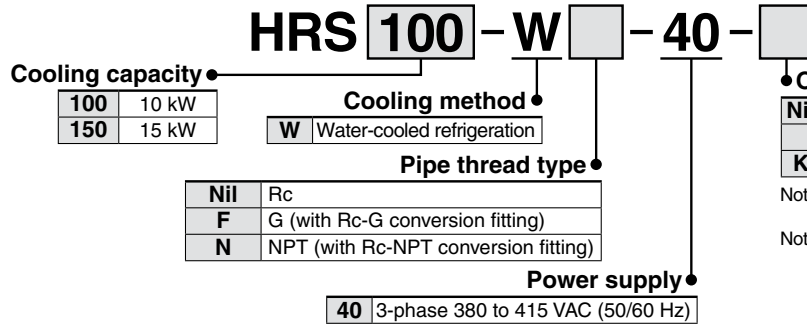

Option

Nil ^{Note 1)}	None
A	With caster adjuster-foot
K ^{Note 2)}	With fluid fill port

Note 1) 400 V type is provided with an earth leakage breaker (-B) as standard.

Note 2) This is a manual fluid fill port that is different from the automatic fluid fill port. Fluid can be supplied manually into the tank without removing the side panel.

(Fluid can be supplied manually for models without option -K if the side panel is removed.)

Specifications

Model		HRS100-W□-40-□	HRS150-W□-40-□	
Cooling method		Water-cooled refrigeration		
Refrigerant		R410A (HFC)		
Control method		PID control		
Ambient temperature ^{Note 1)}		36 to 113°F (2 to 45°C)		
Circulating fluid ^{Note 2)}		Tap water, 15% ethylene glycol aqueous solution, Deionized water		
Set temperature range ^{Note 1)}		41 to 95°F (5 to 35°C)		
Cooling capacity 50/60 Hz ^{Note 3)}	kW	10.0/11.0	14.5/16.5	
Heating capacity 50/60 Hz ^{Note 4)}	kW	1.7/2.2	2.5/3.0	
Temperature stability ^{Note 5)}		±1.8°F (±1.0°C)		
Circulating fluid system	Pump capacity	11/14.8 gal/min (42/56 L/min)		
	Rated flow 50/60 Hz (Outlet) ^{Note 6)} (When circulating fluid outlet port pressure – return port pressure = 36 psi [0.25 MPa])	14.5 to 17.9 gal/min (55/68 L/min)		
	Maximum flow rate 50/60 Hz	164 ft (50 m)		
	Maximum pump head	7.4 to 11.0 gal/min (28/42 L/min)		
	Minimum operating flow rate 50/60 Hz ^{Note 7)}	4.75 gal (18 L)		
Tank capacity		4.75 gal (18 L)		
Circulating fluid outlet, circulating fluid return port		Rc3/4 (Symbol F: G3/4, Symbol N: NPT3/4)		
Pump drain port		Rc1/4 (Symbol F: G1/4, Symbol N: NPT1/4)		
Automatic fluid fill system (Standard)	Supply side pressure range	29 to 73 psi (0.2 to 0.5 MPa)		
	Supply side fluid temperature	41 to 95°F (5 to 35°F)		
	Automatic fluid fill port	Rc1/2 (Symbol F: G1/2, Symbol N: NPT1/2)		
Overflow port		Rc1 (Symbol F: G1, Symbol N: NPT1)		
Fluid contact material		Stainless steel, Copper (Heat exchanger brazing), Brass, Bronze, PTFE, PU, EPDM, PVC, NBR, PE, NR, PBT, PP, POM, Carbon, Ceramic		
Facility water system	Temperature range	41 to 104°F (5 to 40°C)		
	Pressure range	44 to 73 psi (0.3 to 0.5 MPa)		
	Required flow 50/60 Hz	8.7/9.0 gal/min (33/34 L/min)	10/10.6 gal/min (38/40 L/min)	
	Facility water pressure differential	44 psi (0.3 MPa) or more		
	Facility water inlet/outlet	Rc3/4 (Symbol F: G3/4, Symbol N: NPT3/4)		
Fluid contact material		Stainless steel, Copper (Heat exchanger brazing), Bronze, Brass, PTFE, NBR, EPDM		
Electrical system	Power supply		3-phase 200 VAC (50 Hz), 3-phase 200 to 230 VAC (60 Hz) Allowable voltage range ±10% (No continuous voltage fluctuation)	
	Earth leakage breaker (Standard/With handle)	Rated current	A	20
		Sensitivity of leak current	mA	30
	Rated operating current 50/60 Hz ^{Note 5)}	A	6.4/7.2	7.7/9.5
	Rated power consumption 50/60 Hz ^{Note 5)}	kW	3.4/4.4 (4.5/5.0)	4.5/6.0 (5.4/6.6)
Noise level (Front 3.3 ft [1 m]/Height 3.3 ft [1 m]) ^{Note 5)}		70		
Waterproof specification		IPX4		
Accessories		Alarm code list stickers 2 pcs. (English 1 pc./Japanese 1 pc.), Operation Manual (for installation/operation) 2 pcs. (English 1 pc./Japanese 1 pc.), Y-strainer 20A 1 pc., Barrel nipple 20A 1 pc., Drain pan for the pump 1 pc.		
Weight (dry state)		333 lbs (151 kg)	340 lbs (154 kg)	
Compliant standards	CE marking	EMC Directive		
		Machinery Directive		
		2004/108/EC	2006/42/EC	

Note 1) Use a 15% ethylene glycol aqueous solution if operating in a place where the ambient temperature and/or circulating fluid temperature is 50°F (10°C) or less.

Note 2) Use fluid in condition below as the circulating fluid.
Tap water: Standard of The Japan Refrigeration And Air Conditioning Industry Association (JRA GL-02-1994)
15% ethylene glycol aqueous solution: diluted by tap water in condition above without any additives such as antiseptics.
Deionized water: Electric conductivity 1 mS/cm or higher (Electric resistivity 1 MW-cm or lower)

Note 3) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Circulating fluid flow rate: Rated flow, ⑤ Power supply: 200 VAC

Note 4) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid flow rate: Rated flow, ④ Power supply: 200 VAC

Note 5) ① Ambient temperature: 90°F (32°C), ② Circulating fluid: Tap water, ③ Circulating fluid temperature: 68°F (20°C), ④ Load: Same as the cooling capacity, ⑤ Circulating fluid flow rate: Rated flow, ⑥ Power supply: 200 VAC, ⑦ Piping length: Shortest


Note 6) When circulating fluid outlet port pressure – return port pressure = 36 psi (0.25 MPa).

Note 7) Fluid flow rate to maintain the cooling capacity and to keep the circulating fluid discharge pressure to 73 psi (0.5 MPa) or less. If the actual flow rate is lower than this, install a bypass piping.


* If the product is used at altitude of 3280 ft (1000 m) or higher, refer to "Operating Environment/ Storage Environment" (page 21) Item 13 "* For altitude of 3280 ft (1000 m) or higher".

Cooling Capacity


HRS100-A□-20/40-□ (50 Hz)

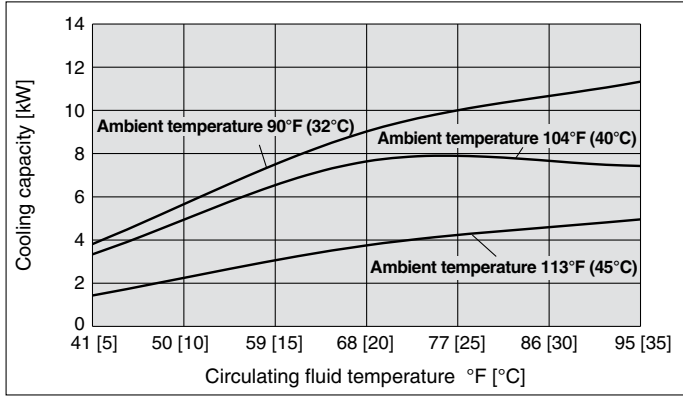


HRS100-A□-20/40-□ (60 Hz)

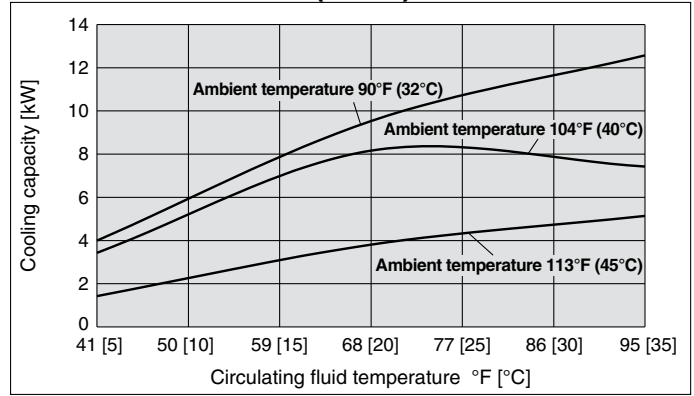


HRS100-W□-20/40-□ (50 Hz)

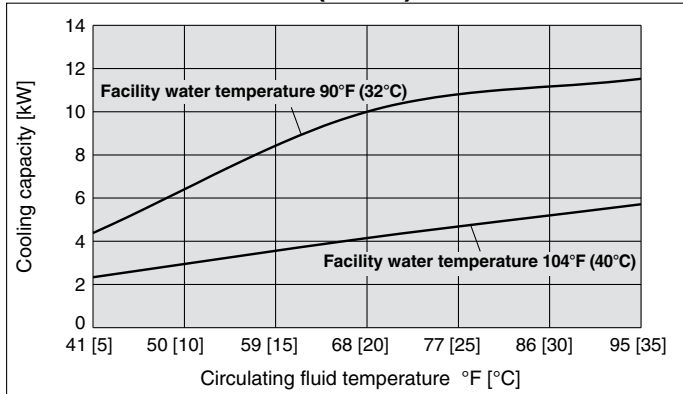


HRS100-W□-20/40-□ (60 Hz)

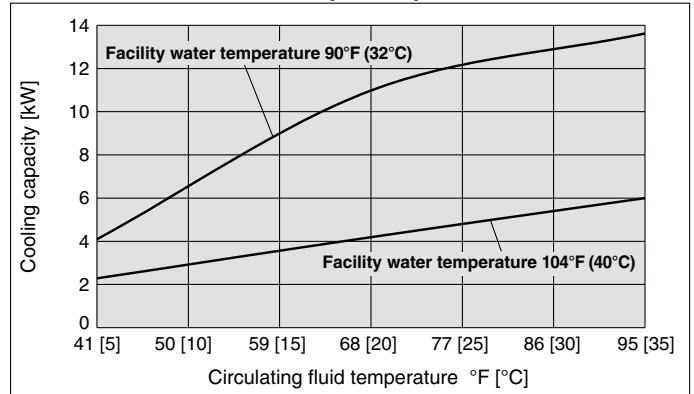


HRS150-A□-20/40-□ (50 Hz)

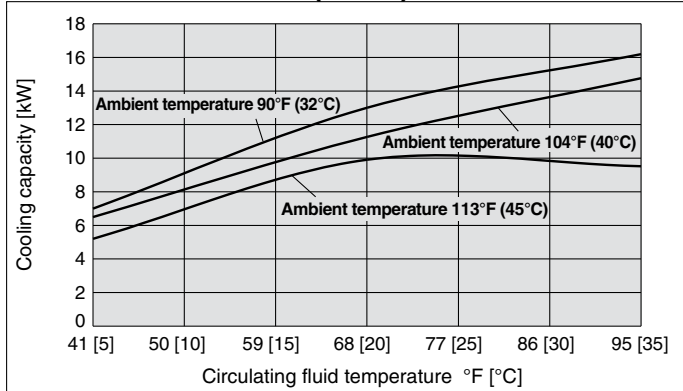


HRS150-A□-20/40-□ (60 Hz)

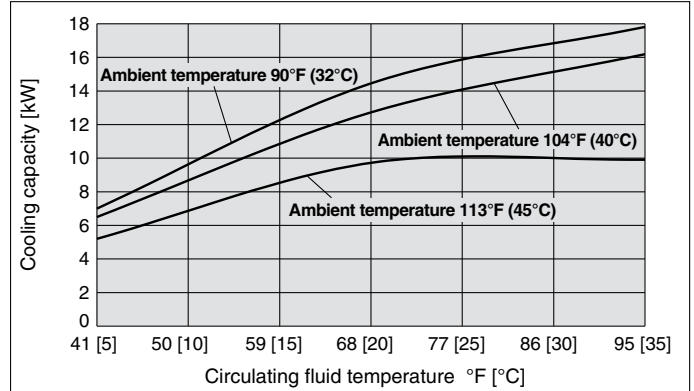

HRS150-W□-20/40-□ (50 Hz)

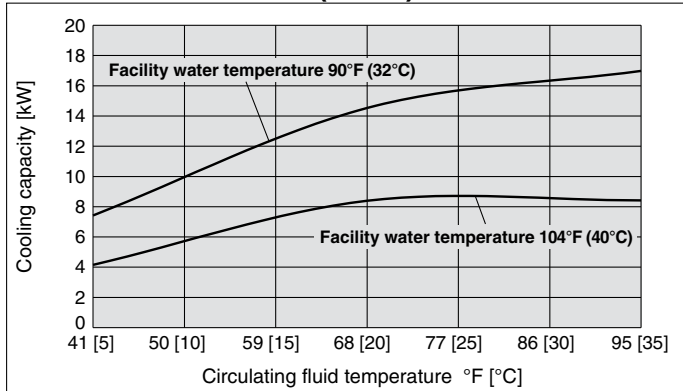


HRS150-W□-20/40-□ (60 Hz)

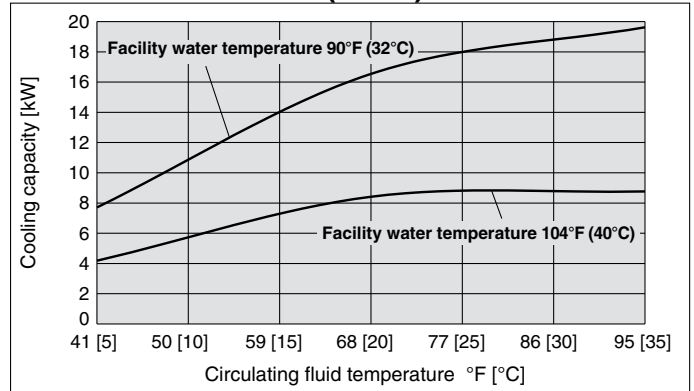

Pump Capacity


HRS100/150-A□-20/40-□
 HRS100/150-W□-20/40-□

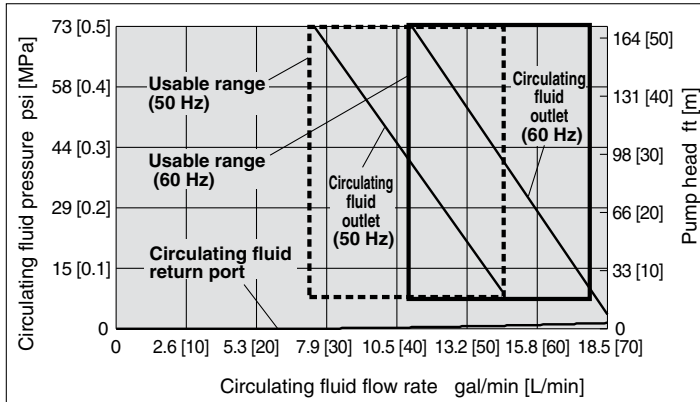


Dimensions

inch [mm]

HRS100/150-A-20 (Air-cooled 200 V type)
HRS100/150-A-40 (Air-cooled 400 V type)

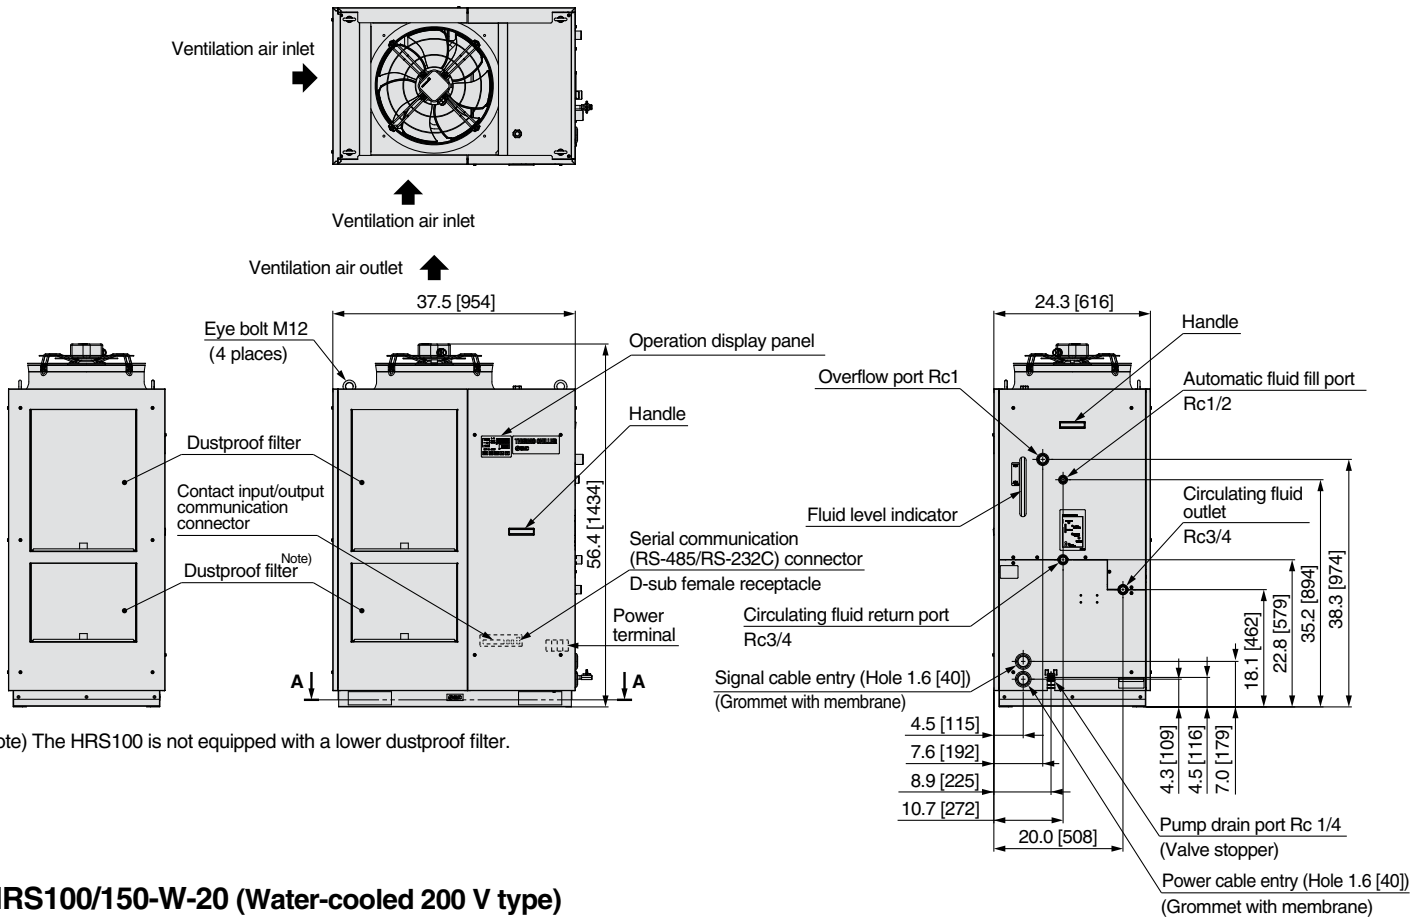


HRS100/150-W-20 (Water-cooled 200 V type)
HRS100/150-W-40 (Water-cooled 400 V type)

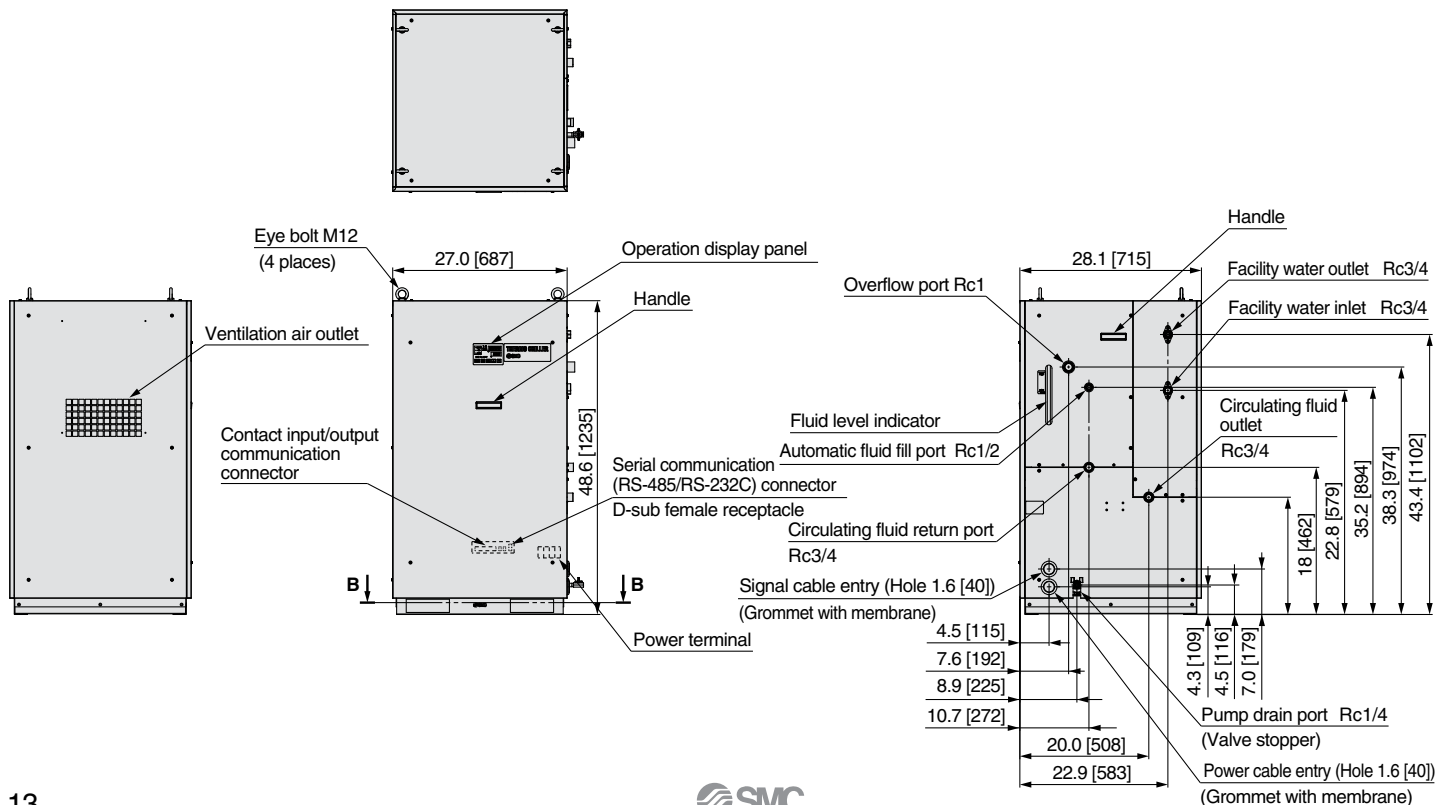


Dimensions

HRS100/150-A-20 (Air-cooled 200 V type)
HRS100/150-A-40 (Air-cooled 400 V type)
Anchor bolt fixing position A

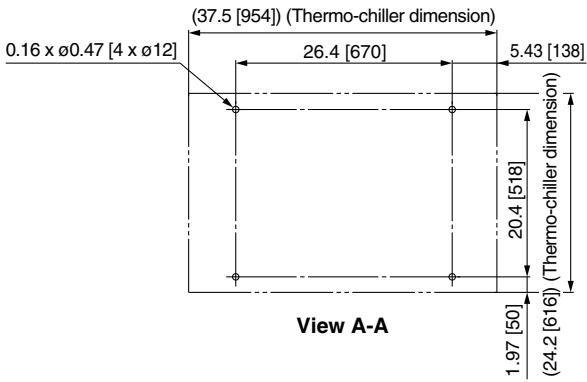


HRS100/150-W-20 (Water-cooled 200 V type)
HRS100/150-W-40 (Water-cooled 400 V type)
Anchor bolt fixing position B

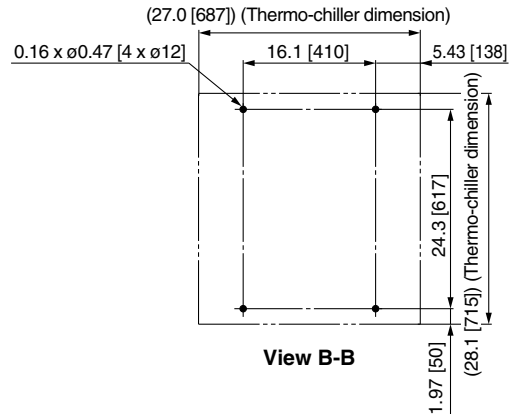


Accessory: Y-strainer mounting view

* Mount it by yourself on the circulating fluid return port.

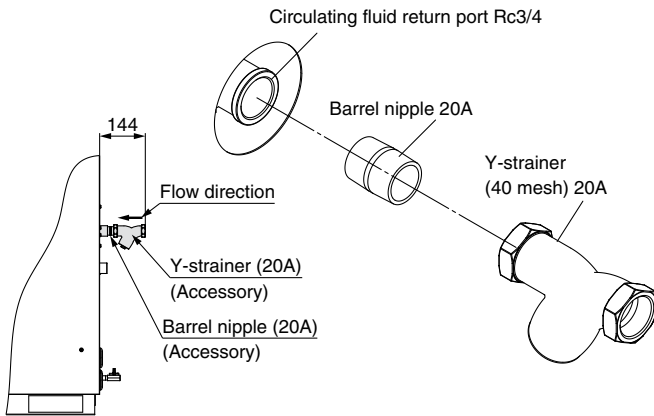

Recommended External Piping Flow

External piping circuit is recommended as shown below.

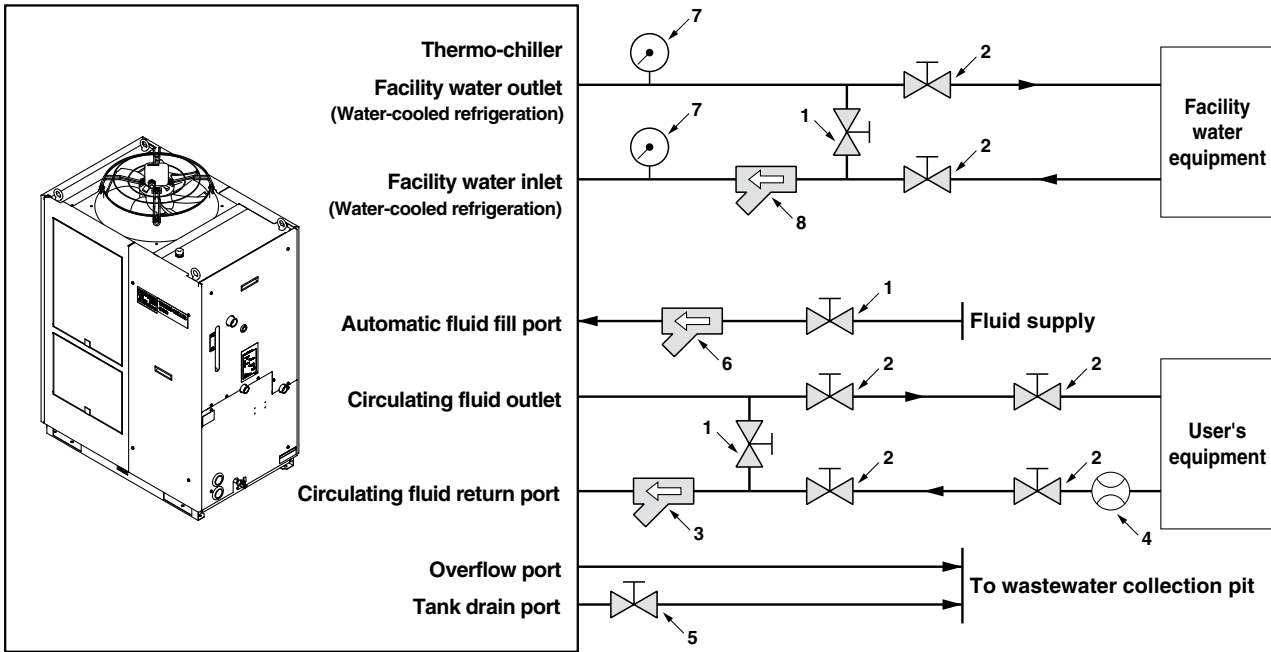

* Ensure that the overflow port is connected to the wastewater collection pit in order to avoid damage to the tank of the thermo-chiller.

No.	Description	Size
1	Valve	Rc1/2
2	Valve	Rc3/4
3	Y-strainer (#40) (Accessory)	Rc3/4
4	Flow meter	Prepare a flow meter with an appropriate flow range.
5	Valve (Part of thermo-chiller)	Rc1/4
6	Y-strainer (#40)	Rc1/2
7	Pressure gauge	0 to 145 psi (0 to 1 MPa)
8	Y-strainer (#40) or filter	Rc3/4

Cable Specifications

Power supply and signal cable should be prepared by user.


Power Cable Specifications

Applicable model	Rated value for thermo-chiller			Power cable examples	
	Power supply	Applicable breaker rated current	Terminal block screw dia.	Cable size	Crimped terminal on the thermo-chiller side
HRS100-A□-20-□ HRS100-W□-20-□	3-phase 200 VAC (50 Hz)	30 A	M5	4 cores x 5.5 mm ² (4 cores x AWG10) (Including grounding cable R5.5-5)	R5.5-5
HRS150-A□-20-□ HRS150-W□-20-□	3-phase 200 to 230 VAC (60 Hz)	40 A		4 cores x 8 mm ² (4 cores x AWG8) (Including grounding cable R8-5)	R8-5
HRS100-A□-40-□ HRS100-W□-40-□ HRS150-A□-40-□ HRS150-W□-40-□	3-phase 380 to 415 VAC (50/60 Hz)	20 A	M5	4 cores x 5.5 mm ² (4 cores x AWG10) (Including grounding cable R5.5-5)	R5.5-5

Note) An example of the cable specifications is when two kinds of vinyl insulated wires with a continuous allowable operating temperature of 158°F (70°C) at 600 V, are used at an ambient temperature of 86°F (30°C). Select the proper size of cable according to an actual condition.

Signal Cable Specifications


Terminal specifications		Cable specifications
Terminal block screw diameter	Recommended crimped terminal	0.75 mm ² (AWG18) Shielded cable
M3	Y-shape crimped terminal 1.25Y-3	

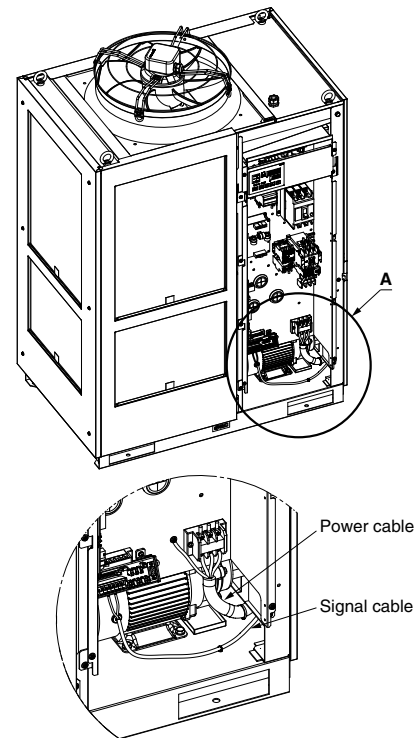

Partially enlarged view A

Operation Display Panel

The basic operation of this unit is controlled through the operation display panel on the front of the product.

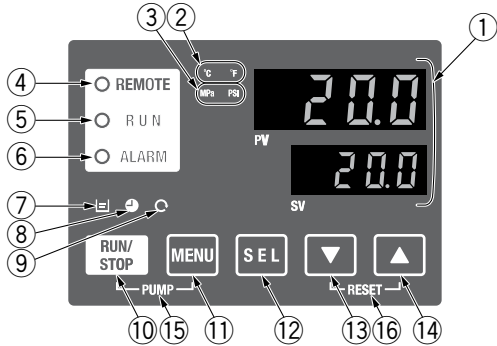

No.	Description	Function
①	Digital display (7-segment and 4 digits)	PV Displays the circulating fluid current discharge temperature and pressure and alarm codes and other menu items (codes). SV Displays the circulating fluid discharge temperature and the set values of other menus.
②	[°C] [°F] lamp	Equipped with a unit conversion function. Displays the unit of displayed temperature (default setting: °C).
③	[MPa] [PSI] lamp	Equipped with a unit conversion function. Displays the unit of displayed pressure (default setting: MPa).
④	[REMOTE] lamp	Enables remote operation (start and stop) by communication. Lights up during remote operation.
⑤	[RUN] lamp	Lights up when the product is started, and goes off when it is stopped. Flashes during stand-by for stop or anti-freezing function, or independent operation of the pump.
⑥	[ALARM] lamp	Flashes with buzzer when alarm occurs.
⑦	[L] lamp	Lights up when the surface of the fluid level indicator falls below the L level.
⑧	[⏸] lamp	Equipped with a timer for start and stop. Lights up when this function is operated.
⑨	[⏻] lamp	Equipped with a power failure auto-restart function, which restarts the product automatically after stopped due to a power failure. Lights up when this function is operated.
⑩	[RUN/STOP] key	Makes the product start or stop.
⑪	[MENU] key	Shifts the main menu (display screen of circulating fluid discharge temperature and pressure) and other menus (for monitoring and entry of set values).
⑫	[SEL] key	Changes the item in menu and enters the set value.
⑬	[▼] key	Decreases the set value.
⑭	[▲] key	Increases the set value.
⑮	[PUMP] key	Press the [MENU] and [RUN/STOP] keys simultaneously. The pump starts running independently to make the product ready for start-up (release the air).
⑯	[RESET] key	Press the [▼] and [▲] keys simultaneously. The alarm buzzer is stopped and the [ALARM] lamp is reset.

Alarm

This unit has alarms as standard, and displays each of them by its alarm code on the PV screen with the [ALARM] lamp ([LOW LEVEL] lamp) lit up on the operation display panel. The alarm can be read out through communication.

Code	Alarm message
AL01	Low level in tank
AL02	High circulating fluid discharge temp.
AL03	Circulating fluid discharge temp. rise
AL04	Circulating fluid discharge temp. drop
AL05	High circulating fluid return temp.
AL06	High circulating fluid discharge pressure
AL07	Abnormal pump operation
AL08	Circulating fluid discharge pressure rise
AL09	Circulating fluid discharge pressure drop
AL10	High compressor intake temp.
AL11	Low compressor intake temp.
AL12	Low super heat temp.
AL13	High compressor discharge pressure
AL15	Refrigeration circuit pressure (high pressure side) drop
AL16	Refrigeration circuit pressure (low pressure side) rise

Code	Alarm message
AL17	Refrigeration circuit pressure (low pressure side) drop
AL18	Compressor running failure
AL19	Communication error
AL20	Memory error
AL21	DC line fuse cut
AL22	Circulating fluid discharge temp. sensor failure
AL23	Circulating fluid return temp. sensor failure
AL24	Compressor intake temp. sensor failure
AL25	Circulating fluid discharge pressure sensor failure
AL26	Compressor discharge pressure sensor failure
AL27	Compressor intake pressure sensor failure
AL28	Pump maintenance
AL29	Fan maintenance
AL30	Compressor maintenance
AL31	Contact input 1 signal detection

Code	Alarm message
AL32	Contact input 2 signal detection
AL37	Compressor discharge temp. sensor failure
AL38	Compressor discharge temp. rise
AL40	Dustproof filter maintenance ^{Note 1)}
AL41	Power stoppage
AL42	Compressor waiting
AL43	Fan failure ^{Note 1)}
AL45	Compressor over current
AL47	Pump over current
AL49	Air exhaust fan stoppage ^{Note 2)}
AL50	Incorrect phase error
AL51	Phase board over current

Note 1) Does not occur on the product of water-cooled refrigeration type.
Note 2) Does not occur on the product of air-cooled refrigeration type.
* For details, read the Operation Manual.

List of Function

No.	Function	Outline
1	Main display	Displays the current and set temperature of the circulating fluid, discharge pressure of the circulating fluid. Changes the circulating fluid set temperature.
2	Alarm display menu	Indicates alarm number when an alarm occurs.
3	Inspection monitor menu	Product temperature, pressure and accumulated operating time can be checked as daily inspection. Use these for daily inspection.
4	Key-lock	Keys can be locked so that set values cannot be changed by operator error.
5	Timer for operation start/stop	Timer is used to set the operation start/stop.
6	Signal for the completion of preparation	A signal is output when the circulating fluid temperature reaches the set temperature, when using contact input/output and serial communication.
7	Offset function	Use this function when there is a temperature offset between the discharge temperature of the thermo-chiller and user's equipment.
8	Reset after power failure	Start operation automatically after the power supply is turned on.
9	Key click sound setting	Operation panel key sound can be set on/off.
10	Changing temp. unit	Temperature unit can be changed. Centigrade (°C) ↔ Fahrenheit (°F)
11	Changing pressure unit	Pressure unit can be changed. MPa ↔ PSI
12	Data reset	Functions can be reset to the default settings (settings when shipped from the factory).
13	Accumulation time reset	Reset function when the pump, the fan or the compressor is replaced. Reset the accumulated time here.
14	Anti-freezing function	Circulating fluid is protected from freezing during winter or at night. Set beforehand if there is a risk of freezing.
15	Warming-up function	When circulating fluid temperature rising time at starting needs shortening during winter or at night, set beforehand.
16	Anti-snow coverage function	If there will be a possibility of the snow coverage due to the change of the installation environment (season, weather), set beforehand.
17	Alarm buzzer sound setting	Alarm sound can be set to on/off.
18	Alarm customizing	Operation during alarm condition and threshold values can be changed depending on the alarm type.
19	Communication	This function is used for contact input/output or serial communication.


For details, refer to the Operation Manual. Please download it via our website, <http://www.smcworld.com>

Communication Function

Contact Input/Output

Item	Specifications	
Connector type	M3 terminal block	
Input signal	Insulation method	Photocoupler
	Rated input voltage	24 VDC
	Operating voltage range	21.6 to 26.4 VDC
	Rated input current	5 mA TYP
	Input impedance	4.7 kΩ
Contact output signal	Rated load voltage	48 VAC or less/30 VDC or less
	Maximum load current	500 mA AC/DC (resistance load)
	Minimum load current	5 VDC 10 mA
Output voltage	24 VDC ±10% 500 mA MAX (No inductive load)	

Circuit diagram

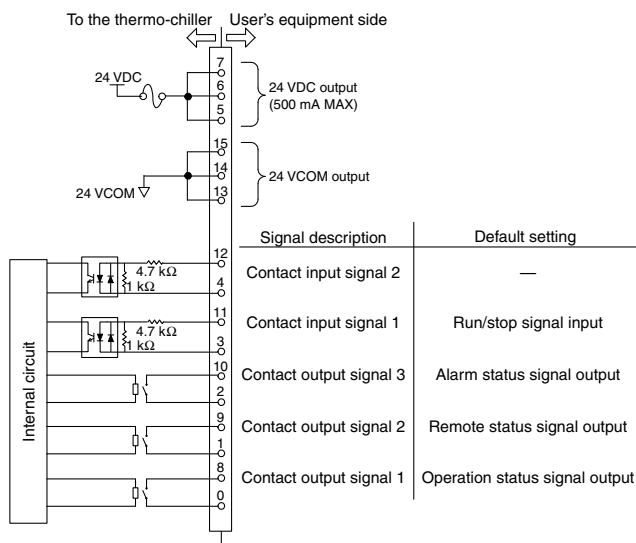

* The pin numbers and output signals can be set by user. For details, refer to the Operation Manual for communication.

Serial Communication

The serial communication (RS-485/RS-232C) enables the following items to be written and read out. For details, refer to the Operation Manual for communication.

Writing

Run/Stop
Circulating fluid temperature setting (SV)

Readout

Circulating fluid present temperature (PV)
Circulating fluid discharge pressure (SV)
Status information
Alarm occurrence information

Item	Specifications	
Connector type	D-sub 9-pin, Female connector	
Protocol	Modicon Modbus compliant/Simple communication protocol	
Standards	EIA standard RS-485	EIA standard RS-232C
Circuit diagram		

* The terminal resistance of RS-485 (120 Ω) can be switched by the operation display panel. For details, refer to the Operation Manual for communication. Do not connect other than in the way shown above, as it can result in failure.

Please download the Operation Manual via our website, <http://www.smcworld.com>

Series HRS100/150

Options

Note) Options have to be selected when ordering the thermo-chiller. It is not possible to add them after purchasing the unit.

A Option symbol


With Caster Adjuster-Foot

HRS□-□-□-□-**A**

● With caster adjuster-foot

Unfixed casters and adjuster feet stops are mounted.

Applicable model	Dimension in [mm]		
	A	B	C
HRS100/150-A-20/40-A	32.7 [830]	11.9 [302]	61.1 [1552]
HRS100/150-W-20/40-A	22.4 [570]	15.8 [401]	53.5 [1353]

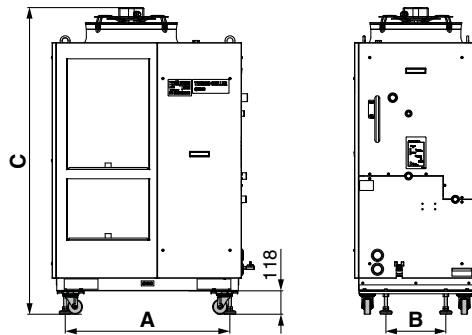

B Option symbol


With Earth Leakage Breaker

HRS□-□-□-20-**B**

● With earth leakage breaker

A leakage breaker is built in to automatically stop the supply power when it has short-circuit, over current or electrical leakage.

Applicable model	Rated current [A]	Sensitivity of leak current [mA]	Short circuit display method
HRS100-A/W-20	30	30	Mechanical button
HRS150-A/W-20	40		

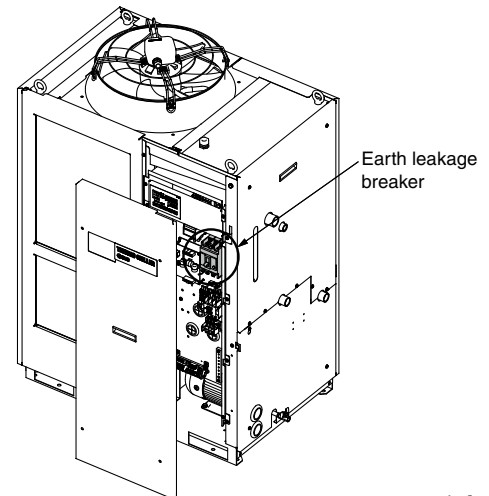




K Option symbol

With Fluid Fill Port

HRS□-□-□-□-**K**

● With fluid fill port

When the automatic fluid fill port is not used, fluid can be supplied manually without removing the panel.

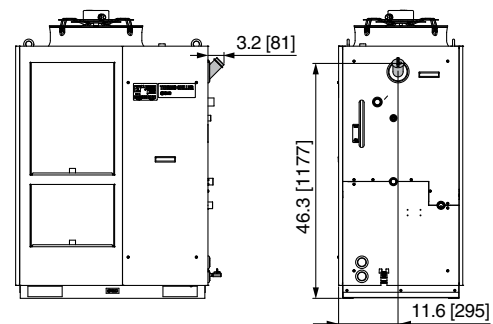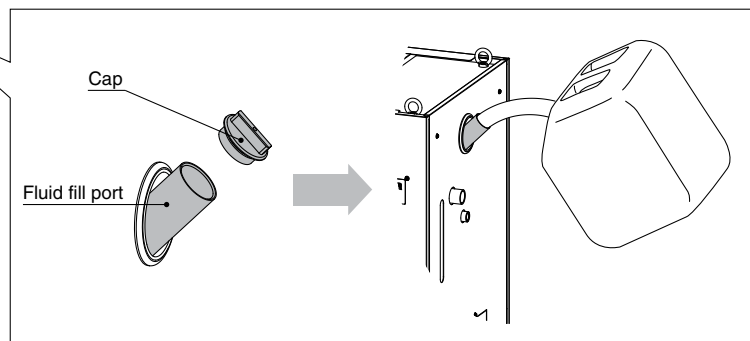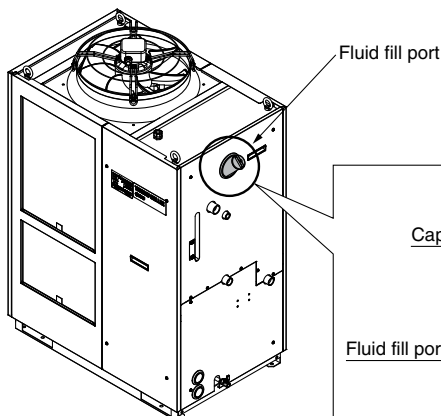

* Dimensions are common to all models.

Series HRS100/150

Optional Accessories


① Piping Conversion Fitting

This is a fitting to change the port from Rc to G or NPT.


- Circulating fluid outlet, Circulating fluid return port Rc3/4 → NPT3/4 or G3/4
- Overflow port Rc1 → NPT1 or G1
- Automatic fluid fill port Rc1/2 → NPT1/2 or G1/2
- Facility water inlet, Facility water outlet Rc3/4 → NPT3/4 or G3/4 (for HRS-EP029 or HRS-EP030)

(It is not necessary to purchase this when pipe thread type F or N is selected in “How to Order” since it is included in the product.)

Part no.	Contents	Applicable model	Material
HRS-EP027	NPT thread conversion fitting set	HRS100/150-A-□	Stainless steel
HRS-EP028	G thread conversion fitting set		
HRS-EP029	NPT thread conversion fitting set	HRS100/150-W-□	
HRS-EP030	G thread conversion fitting set		

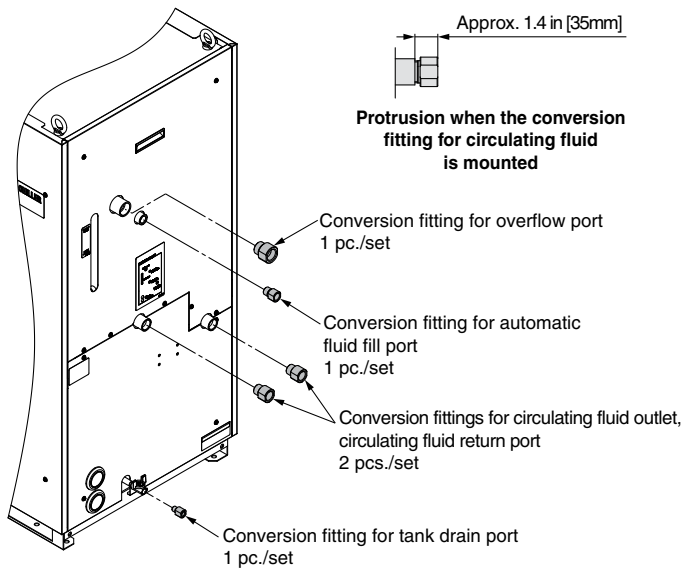

HRS-EP027, HRS-EP028

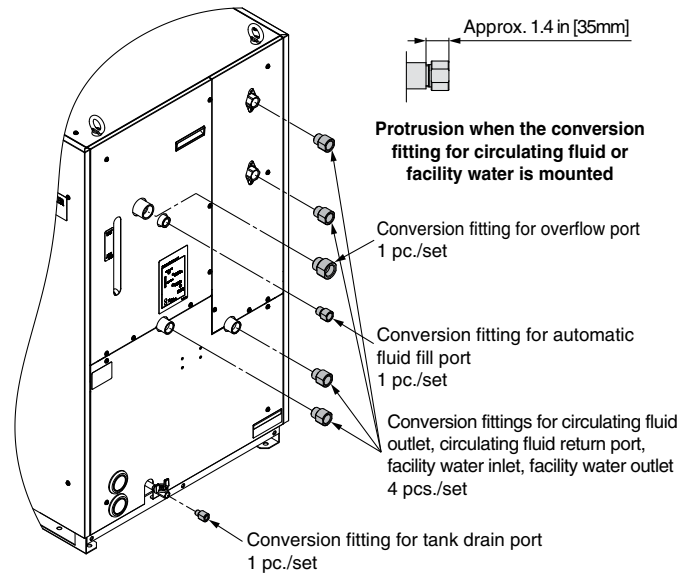

HRS-EP029, HRS-EP030

② Caster Adjuster-foot Kit

This is a set of unfixed casters and adjuster feet stop.

When installed by user, it is necessary to lift the thermo-chiller by a forklift or sling work.

Carefully read the procedure manual included with this kit before performing the installation.

Part no.	Applicable model	Dimension in [mm]	
		A	B
HRS-KS003	HRS100/150-A-□-□	32.7 [830]	11.9 [302]
HRS-KS002	HRS100/150-W-□-□	22.4 [570]	15.8 [401]

Parts List

Description
Procedure manual
Caster adjuster-foot bracket (2 pcs.)
Fixing bolt (M8) (8 pcs.)

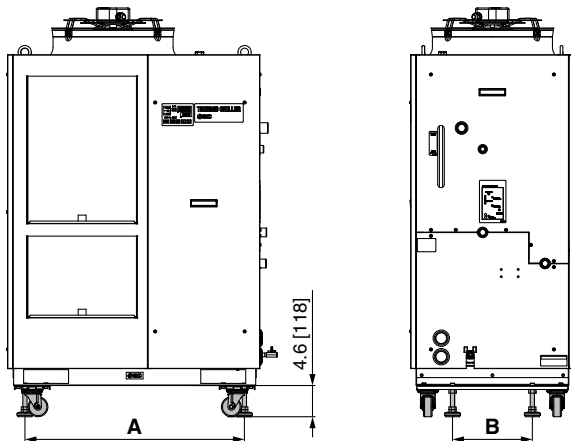


Fig. 1 Mounting view

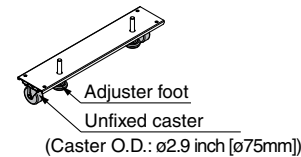


Fig. 2 Caster adjuster-foot bracket (2 pcs.)







Fig. 3 Fixing bolt (8 pcs.)

③ Electric Conductivity Control Set

The set indicates and controls the electric conductivity of the circulating fluid. Refer to the Operation Manual for details.

Part no.	Applicable model
HRS-DI010	HRS100 -□□-□
	HRS150 -□□-□

Measurement range of electric conductivity	2.0 to 48.0 $\mu\text{S/cm}$
Set range of electric conductivity target	5.0 to 45.0 $\mu\text{S/cm}$
Set range of electric conductivity hysteresis	2.0 to 10.0 $\mu\text{S/cm}$
Operating temperature range (Circulating fluid temperature)	41 to 140°F (5 to 60°C)
Power consumption	400 mA or less
Installation environment	Indoors

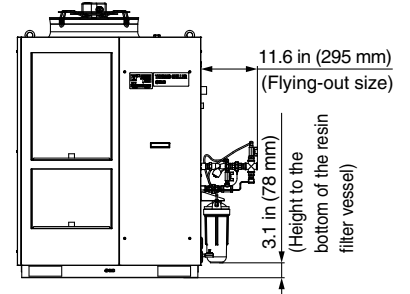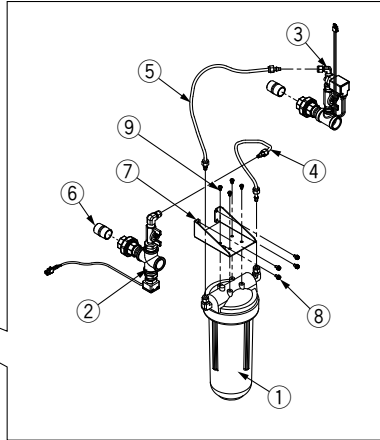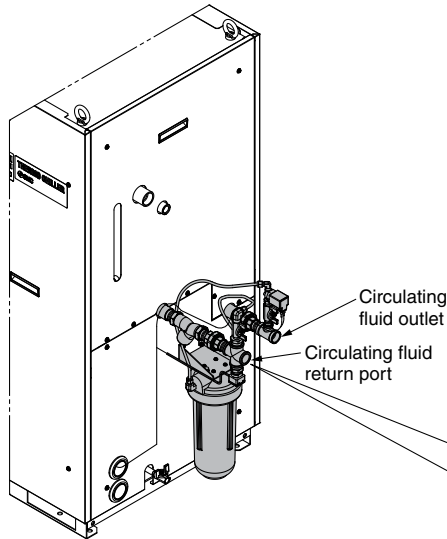



Parts List

No.	Description
①	DI filter vessel (resin)
②	DI sensor assembly
③	DI control piping assembly
④	DI filter outlet tube
⑤	DI filter inlet tube
⑥	Nipple (2 pcs.)
⑦	Mounting bracket
⑧	Mounting screw (4 pcs.)
⑨	Tapping screw (4 pcs.)

④ Bypass Piping Set

Ensure that the circulating fluid flow rate will be more than the minimum required flow rate using a bypass piping set so that the circulating fluid discharge pressure would be 73 psi (0.5 MPa) or less. Otherwise, an alarm due to circulating fluid discharge pressure or pump over current may occur.

Part no.	Applicable model	Minimum operating flow rate (50/60 Hz)
HRS-BP007	HRS100 -□□-□	7.4/11.0 gal/min [28/42 L/min]
	HRS150 -□□-□	

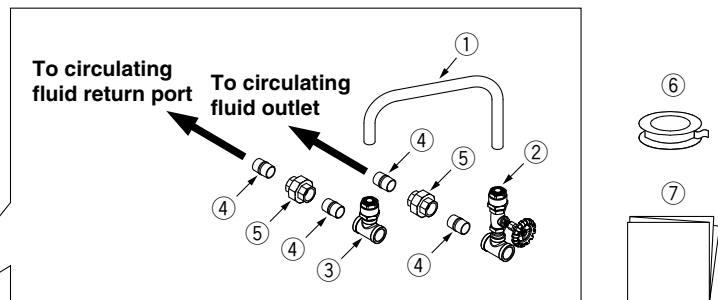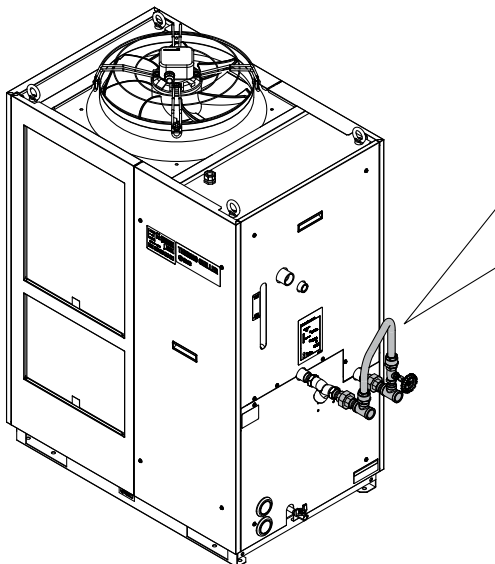

Parts List


No.	Description
①	Hose (I.D.: 0.6 in [15 mm], Length: 27.6 in [700 mm])
②	Outlet piping assembly (With globe valve)
③	Return piping assembly
④	Barrel nipple (Size: 3/4 inch) (2 pcs.)
⑤	Union (Size: 3/4 inch) (2 pcs.)
⑥	Sealant tape
⑦	Operation Manual

Series HRS100/150

⑤ Relief Valve Set

If a solenoid valve is installed in the user's system and the circulating fluid supply stops or decreases during thermo-chiller operation, the circulating fluid discharge pressure of the thermo-chiller increases and an alarm may occur. The relief valve set opens the valve when the pressure exceeds the set pressure level, which prevents pressure increase.

Part no.	Applicable model
HRS-BP008	HRS100-□□-□ HRS150-□□-□

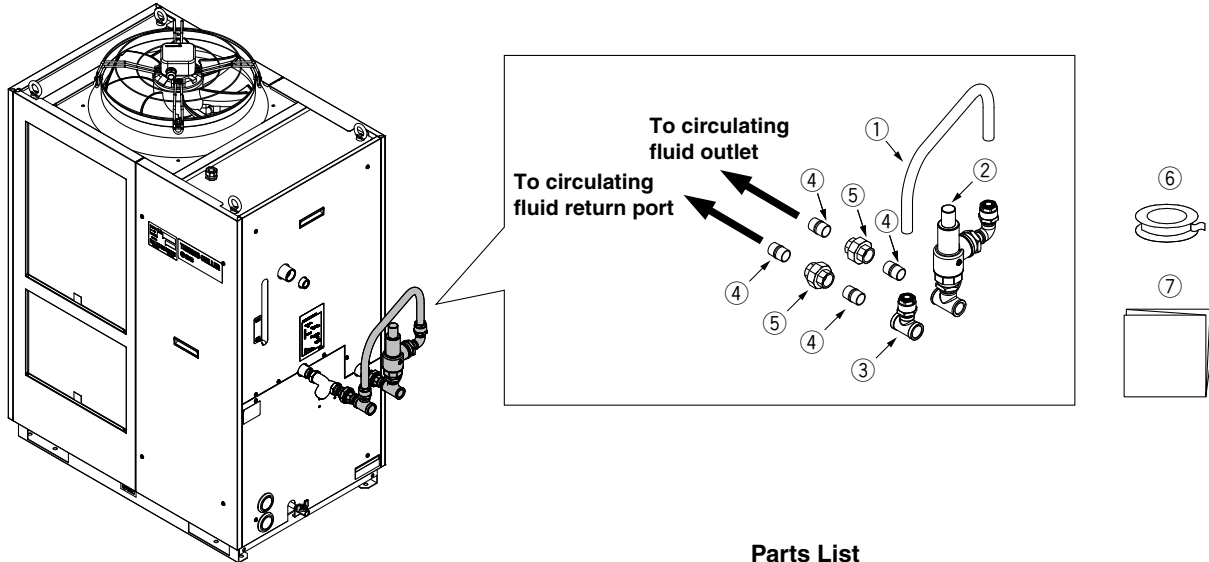

(The figure shows the HRS-150-A-20.)


- Relief valve set pressure: 46 psi [0.32 MPa] (The relief valve starts to open when the circulating fluid discharge pressure reaches 46 psi [0.32 MPa].)
- The setting is made so that the circulating fluid discharge pressure of the thermo-chiller does not exceed 73 psi [0.5 MPa] even when the thermo-chiller is operated at 60 Hz and the water is no longer supplied to the user's system.
- The set pressure of the relief valve should not be adjusted (or changed) by the user. If the set pressure needs to be adjusted, it should be conducted by authorized engineers.

Parts List

No.	Description
①	Hose (I.D.: 0.6 in [15 mm], Length: 27.5 in [700 mm])
②	Outlet piping assembly (With globe valve)
③	Return piping assembly
④	Barrel nipple (Size: 3/4 inch) (4 pcs.)
⑤	Union (Size: 3/4 inch) (4 pcs.)
⑥	Sealant tape
⑦	Operation Manual

⑥ Snow Protection Hood



Snow protection hood for air-cooled chiller. According to the mounting direction of the snow protection hood, the ventilation from the fan can be selected from four directions, front, rear, left and right.

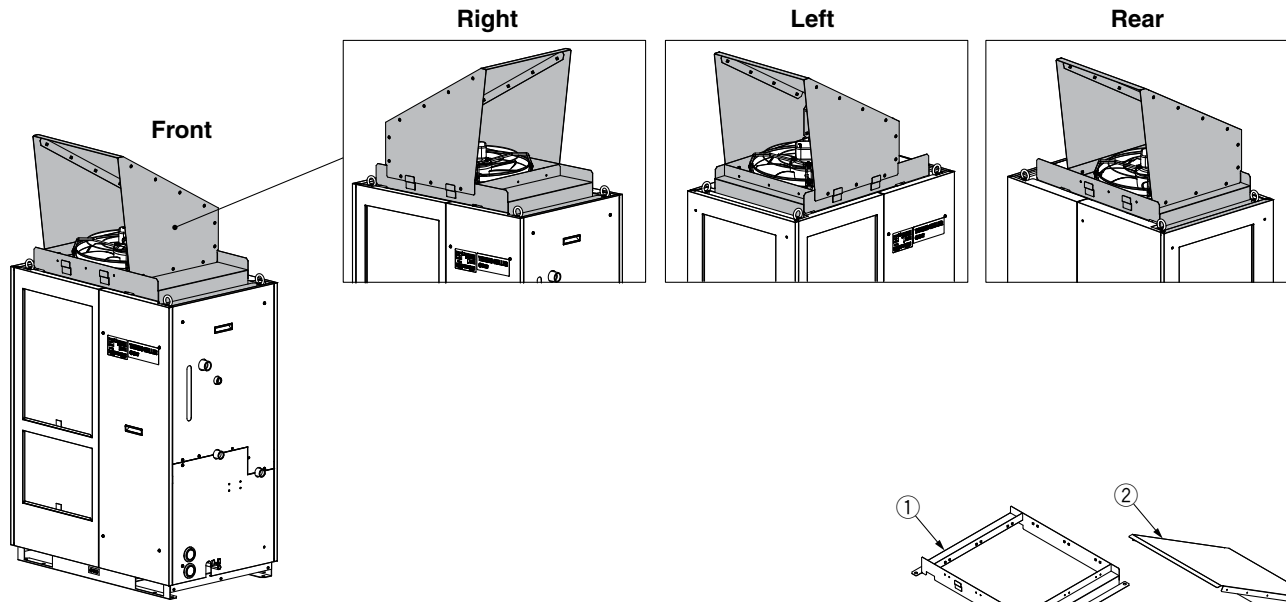

Part no.	Applicable model
HRS-BK005	HRS100-A □□
	HRS150-A □□

Parts List

No.	Description	Qty.
①	Snow protection hood base	1
②	Snow protection hood A	1
③	Snow protection hood B	2
④	Assembly/Mounting screw	18

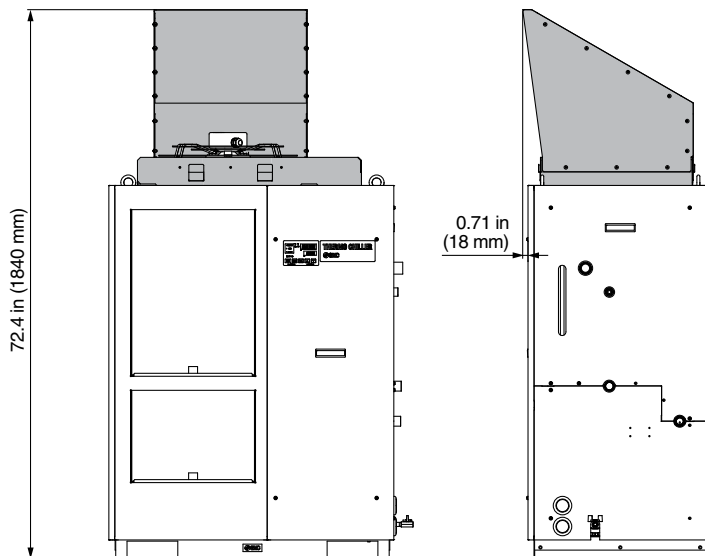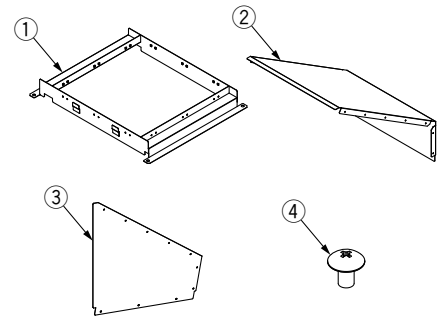

Mounting condition for HRS-BK005

* This hood does not completely prevent snow from entering the inside of the chiller.

Cooling Capacity Calculation

Required Cooling Capacity Calculation

Example 1: When the heat generation amount in the user's equipment is known.


The heat generation amount can be determined based on the power consumption or output of the heat generating area — i.e. the area requiring cooling — within the user's equipment.*

① Derive the heat generation amount from the power consumption.

Power consumption **P**: 7 [kW]

$$Q = P = 7 \text{ [kW]}$$

$$\text{Cooling capacity} = \text{Considering a safety factor of 20\%, } 7 \text{ [kW]} \times 1.2 = \boxed{8.4 \text{ [kW]}}$$

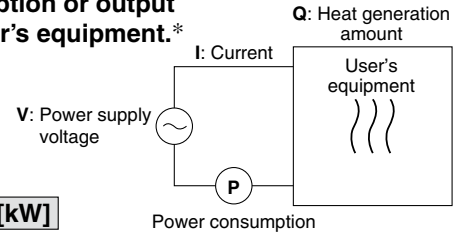

② Derive the heat generation amount from the power supply output.

Power supply output **VI**: 8.8 [kVA]

$$Q = P = V \times I \times \text{Power factor}$$

In this example, using a power factor of 0.85:

$$= 8.8 \text{ [kVA]} \times 0.85 = 7.5 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.5 \text{ [kW]} \times 1.2 = \boxed{9.0 \text{ [kW]}}$$

③ Derive the heat generation amount from the output.

Output (shaft power etc.) **W**: 13 [kW]

$$Q = P = \frac{W}{\text{Efficiency}}$$

In this example, using an efficiency of 0.7:

$$= \frac{5.1}{0.7} = 7.3 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.3 \text{ [kW]} \times 1.2 = \boxed{8.8 \text{ [kW]}}$$

* The above examples calculate the heat generation amount based on the power consumption. The actual heat generation amount may differ due to the structure of the user's equipment. Be sure to check it carefully.

Example 2: When the heat generation amount in the user's equipment is not known.

Obtain the temperature difference between inlet and outlet by circulating the circulating fluid inside the user's equipment.

Heat generation amount by user's equipment **Q** : Unknown [W] ([J/s])
 Circulating fluid : Tap water*
 Circulating fluid mass flow rate **qm** : (= $\rho \times qv + 60$) [kg/s]
 Circulating fluid density ρ : 1 [kg/L]
 Circulating fluid (volume) flow rate **qv** : 35 [L/min]
 Circulating fluid specific heat **C** : 4.186×10^3 [J/(kg·K)]
 Circulating fluid outlet temperature **T1** : 293 [K] (20 [°C])
 Circulating fluid return temperature **T2** : 296 [K] (23 [°C])
 Circulating fluid temperature difference ΔT : 3 [K] (= $T_2 - T_1$)
 Conversion factor: minutes to seconds (SI units) : 60 [s/min]

* Refer to page 20 for the typical physical property value of tap water or other circulating fluids.


$$Q = qm \times C \times (T_2 - T_1)$$

$$= \frac{\rho \times qv \times C \times \Delta T}{60} = \frac{1 \times 35 \times 4.186 \times 10^3 \times 3.0}{60}$$

$$= 7325 \text{ [J/s]} \approx 7325 \text{ [W]} = 7.3 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.3 \text{ [kW]} \times 1.2 = \boxed{8.8 \text{ [kW]}}$$

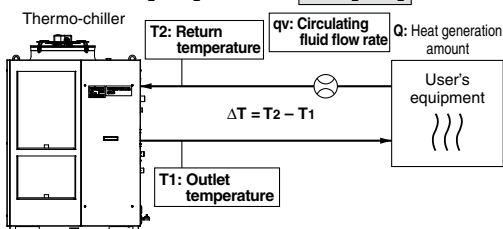

Example of conventional measurement units (Reference)

Heat generation amount by user's equipment **Q** : Unknown [cal/h] → [W]
 Circulating fluid : Tap water*
 Circulating fluid weight flow rate **qm** : (= $\rho \times qv \times 60$) [kgf/h]
 Circulating fluid weight volume ratio γ : 1 [kgf/L]
 Circulating fluid (volume) flow rate **qv** : 35 [L/min]
 Circulating fluid specific heat **C** : 1.0×10^3 [cal/(kgf·°C)]
 Circulating fluid outlet temperature **T1** : 20 [°C]
 Circulating fluid return temperature **T2** : 23 [°C]
 Circulating fluid temperature difference ΔT : 3 [°C] (= $T_2 - T_1$)
 Conversion factor: hours to minutes : 60 [min/h]
 Conversion factor: kcal/h to kW : 860 [(cal/h)/W]

$$Q = \frac{qm \times C \times (T_2 - T_1)}{860}$$

$$= \frac{\gamma \times qv \times 60 \times C \times \Delta T}{860}$$

$$= \frac{1 \times 35 \times 60 \times 1.0 \times 10^3 \times 3.0}{860}$$

$$\approx 7325 \text{ [W]} = 7.3 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.3 \text{ [kW]} \times 1.2 = \boxed{8.8 \text{ [kW]}}$$

Required Cooling Capacity Calculation

Example 3: When there is no heat generation, and when cooling the object below a certain temperature and period of time.

Heat quantity by cooled substance (per unit time) **Q** : Unknown [W] [(J/s)]
 Cooled substance : Water
 Cooled substance mass **m** : (= ρ × V) [kg]
 Cooled substance density ρ : 1 [kg/L]
 Cooled substance total volume **V** : 150 [L]
 Cooled substance specific heat **C** : 4.186 × 10³ [J/(kg·K)]
 Cooled substance temperature when cooling begins **To** : 303 [K] (30 [°C])
 Cooled substance temperature after t hour **Tt** : 293 [K] (20 [°C])
 Cooling temperature difference **ΔT** : 10 [K] (= **To** - **Tt**)
 Cooling time **Δt** : 900 [s] (= 15 [min])


* Refer to the following for the typical physical property values by circulating fluid.

$$Q = \frac{m \times C \times (T_t - T_o)}{\Delta t} = \frac{\rho \times V \times C \times \Delta T}{\Delta t}$$

$$= \frac{1 \times 150 \times 4.186 \times 10^3 \times 10}{900} = 6977 \text{ [J/s]} \approx 7.0 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.0 \text{ [kW]} \times 1.2 = \boxed{8.4 \text{ [kW]}}$$

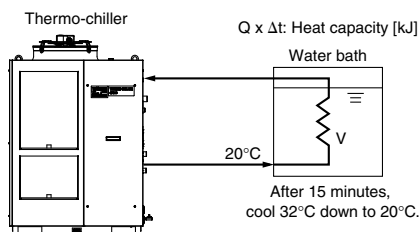

Example of conventional measurement units (Reference)

Heat quantity by cooled substance (per unit time) **Q** : Unknown [cal/h] → [W]
 Cooled substance : Water
 Cooled substance weight **m** : (= ρ × V) [kgf]
 Cooled substance weight volume ratio γ : 1 [kgf/L]
 Cooled substance total volume **V** : 150 [L]
 Cooled substance specific heat **C** : 1.0 × 10³ [cal/(kgf·°C)]
 Cooled substance temperature when cooling begins **To** : 30 [°C]
 Cooled substance temperature after t hour **Tt** : 20 [°C]
 Cooling temperature difference **ΔT** : 10 [°C] (= **To** - **Tt**)
 Cooling time **Δt** : 15 [min]
 Conversion factor: hours to minutes : 60 [min/h]
 Conversion factor: kcal/h to kW : 860 [(cal/h)/W]

$$Q = \frac{m \times C \times (T_t - T_o)}{\Delta t \times 860} = \frac{\gamma \times V \times 60 \times C \times \Delta T}{\Delta t \times 860}$$

$$= \frac{1 \times 150 \times 60 \times 1.0 \times 10^3 \times 10}{15 \times 860}$$

$$\approx 6977 \text{ [W]} = 7.0 \text{ [kW]}$$

Cooling capacity = Considering a safety factor of 20%,

$$7.0 \text{ [kW]} \times 1.2 = \boxed{8.4 \text{ [kW]}}$$

Note) This is the calculated value by changing the fluid temperature only. Thus, it varies substantially depending on the water bath or piping shape.

Precautions on Cooling Capacity Calculation

1. Heating capacity

When the circulating fluid temperature is set above room temperature, it needs to be heated by the thermo-chiller. The heating capacity depends on the circulating fluid temperature. Consider the radiation rate and heat capacity of the user's equipment and check beforehand if the required heating capacity is provided.

2. Pump capacity

<Circulating fluid flow rate>

Circulating fluid flow rate varies depending on the circulating fluid discharge pressure. Consider the installation height difference between the thermo-chiller and the user's equipment, and the piping resistance such as circulating fluid pipings, or piping size, or piping curves in the machine. Check beforehand if the required flow is achieved, using the pump capacity curves.

<Circulating fluid discharge pressure>

Circulating fluid discharge pressure has the possibility to increase up to the maximum pressure in the pump capacity curves. Check beforehand if the circulating fluid pipings or circulating fluid circuit of the user's equipment are fully durable against this pressure.

Circulating Fluid Typical Physical Property Values

1. This catalog uses the following values for density and specific heat in calculating the required cooling capacity.

Density ρ: 1 [kg/L] (or, using conventional unit system, weight volume ratio γ = 1 [kgf/L])

Specific heat C: 4.19 × 10³ [J/(kg·K)] (or, using conventional unit system, 1 × 10³ [cal/(kgf·°C)])

2. Values for density and specific heat change slightly according to temperature shown below. Use this as a reference.

Water

Physical property value Temperature	Density ρ [kg/L]	Specific heat C [J/(kg·K)]	Conventional unit system	
			Weight volume ratio γ [kgf/L]	Specific heat C [cal/(kgf·°C)]
41°F (5°C)	1.00	4.2 × 10 ³	1.00	1 × 10 ³
50 (10)	1.00	4.19 × 10 ³	1.00	1 × 10 ³
59 (15)	1.00	4.19 × 10 ³	1.00	1 × 10 ³
68 (20)	1.00	4.18 × 10 ³	1.00	1 × 10 ³
77 (25)	1.00	4.18 × 10 ³	1.00	1 × 10 ³
86 (30)	1.00	4.18 × 10 ³	1.00	1 × 10 ³
95 (35)	0.99	4.18 × 10 ³	0.99	1 × 10 ³
104 (40)	0.99	4.18 × 10 ³	0.99	1 × 10 ³

Physical property value Temperature	Density ρ [kg/L]	Specific heat C [J/(kg·K)]	Conventional unit system	
			Weight volume ratio γ [kgf/L]	Specific heat C [cal/(kgf·°C)]
41°F (5°C)	1.02	3.91 × 10 ³	1.02	0.93 × 10 ³
50 (10)	1.02	3.91 × 10 ³	1.02	0.93 × 10 ³
59 (15)	1.02	3.91 × 10 ³	1.02	0.93 × 10 ³
68 (20)	1.01	3.91 × 10 ³	1.01	0.93 × 10 ³
77 (25)	1.01	3.91 × 10 ³	1.01	0.93 × 10 ³
86 (30)	1.01	3.91 × 10 ³	1.01	0.94 × 10 ³
95 (35)	1.01	3.91 × 10 ³	1.01	0.94 × 10 ³
104 (40)	1.01	3.92 × 10 ³	1.01	0.94 × 10 ³

Note) The above shown are reference values. Contact circulating fluid supplier for details.



Series HRS100/150 Specific Product Precautions 1

Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to "Handling Precautions for SMC Products" and the Operation Manual on SMC website, <http://www.smcworld.com>

Design

Warning

1. This catalog shows the specifications of a single unit.

- 1) Check the specifications of the single unit (contents of this catalog) and thoroughly consider the adaptability between the user's system and this unit.
- 2) Although the protection circuit as a single unit is installed, prepare a drain pan, water leakage sensor, discharge air facility, and emergency stop equipment, depending on the user's operating condition. Also, the user is requested to carry out the safety design for the whole system.

2. When attempting to cool areas that are open to the atmosphere (tanks, pipes), plan your piping system accordingly.

When cooling open-air external tanks, arrange the piping so that there are coil pipes for cooling inside the tanks, and to carry back the entire flow volume of circulating fluid that is released.

3. Use non-corrosive material for fluid contact of circulating fluid and facility water.

Using corrosive materials such as aluminum or iron for fluid contact parts such as piping may cause clogging or leakage in the circulating fluid and facility water circuits. Provide protection against corrosion when you use the product.

4. The facility water outlet temperature (water-cooled type) may increase up to around 140°F (60°C).

When selecting the facility water pipings, consider the suitability for temperature.

Selection

Warning

Model selection

For selecting a model of thermo-chiller, it is required to know the heat generation amount of the user's equipment. Obtain the heat generation amount, referring to "Cooling Capacity Calculation" on pages 19 and 20 before selecting a model.

Handling

Warning

Thoroughly read the Operation Manual.

Read the Operation Manual completely before operation, and keep this manual available whenever necessary.

Operating Environment/Storage Environment

Warning

1. Do not use in the following environment as it will lead to a breakdown.

- 1) In locations where water vapor, salt water, and oil may splash on the product.
- 2) In locations where there are dust and particles.
- 3) In locations where corrosive gases, organic solvents, chemical fluids, or flammable gases are present. (This product is not explosion proof.)
- 4) In locations where the ambient temperature exceeds the limits as mentioned below.

During transportation/storage: 5 to 122°F (–15° to 50°C) (But as long as water or circulating fluid are not left inside the pipings)

During operation: 5 to 113°F (–5° to 45°C) (However, use a 15% ethylene glycol aqueous solution if operating in a place where the ambient temperature or circulating fluid temperature is 50°F (10°C) or less.)

- 5) In locations where condensation may occur.
- 6) In locations which receive direct sunlight or radiated heat.
- 7) In locations where there is a heat source nearby and the ventilation is poor.
- 8) In locations where temperature substantially changes.
- 9) In locations where strong magnetic noise occurs.
(In locations where strong electric fields, strong magnetic fields and surge voltage occur.)
- 10) In locations where static electricity occurs, or conditions which make the product discharge static electricity.
- 11) In locations where high frequency occurs.
- 12) In locations where damage is likely to occur due to lightning.
- 13) In locations at altitude of 9842 ft (3000 m) or higher (Except during storage and transportation)

* For altitude of 3281 ft (1000 m) or higher

Because of lower air density, the heat radiation efficiencies of the devices in the product will be lower in the location at altitude of 1000 m or higher. Therefore, the maximum ambient temperature to use and the cooling capacity will lower according to the descriptions in the table below.

Select the thermo-chiller considering the descriptions.

- ① Upper limit of ambient temperature: Use the product in ambient temperature of the described value or lower at each altitude.
- ② Cooling capacity coefficient: The product's cooling capacity will lower to one that multiplied by the described value at each altitude.

Altitude ft [m]	① Upper limit of ambient temperature °F [°C]	② Cooling capacity
Less than 3281 [1000]	113 [45]	1.00
Less than 4921 [1500]	108 [42]	0.85
Less than 6561 [2000]	100 [38]	0.80
Less than 8202 [2500]	95 [35]	0.75
Less than 9842 [3000]	90 [32]	0.70

- 14) In locations where strong impacts or vibrations occur.
- 15) In locations where a massive force strong enough to deform the product is applied or a weight from a heavy object is applied.
- 16) In locations where there is not sufficient space for maintenance.
- 17) In locations where liquid that exceeds the conditions required for the degrees of protection IPX4 may splash on the product.
- 18) Insects or plants may enter the unit.

2. The product is not designed for clean room usage. It generates particles internally.



Series HRS100/150 Specific Product Precautions 2


Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to "Handling Precautions for SMC Products" and the Operation Manual on SMC website, <http://www.smcworld.com>

Transportation/Transfer/Movement

Warning

1. This product will require an acceptance with the product not unloaded from the truck, and the user will need to unload the product by himself. Prepare a forklift.

The product will be delivered in the packaging shown below.

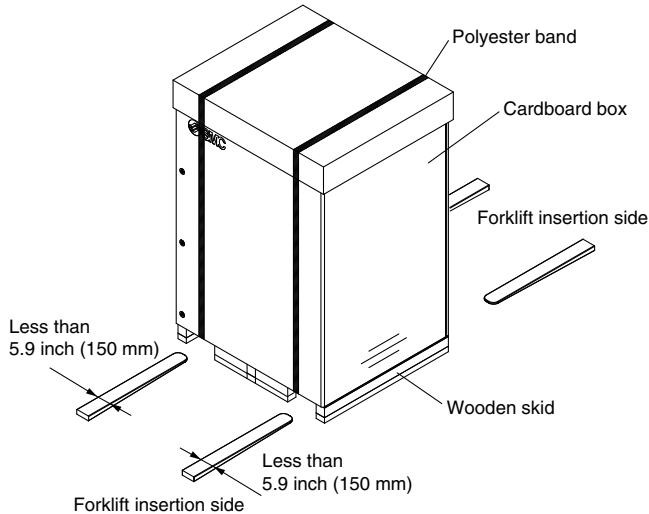

<When packaged>

Model	Weight lb [kg]	Dimensions inch [mm]
HRS100-A□-20	467 [212]	Height 62.4 x Width 46.7 x Depth 37.6 [Height 1585 x Width 1185 x Depth 955]
HRS150-A□-20	481 [218]	Height 62.4 x Width 46.7 x Depth 37.6 [Height 1585 x Width 1185 x Depth 955]
HRS100-W□-20	410 [186]	Height 58.5 x Width 36.4 x Depth 37.6 [Height 1485 x Width 925 x Depth 955]
HRS150-W□-20	417 [189]	Height 58.5 x Width 36.4 x Depth 37.6 [Height 1485 x Width 925 x Depth 955]
HRS100-A□-20-A	509 [231]	Height 67.3 x Width 46.7 x Depth 37.6 [Height 1710 x Width 1185 x Depth 955]
HRS150-A□-20-A	522 [237]	Height 67.3 x Width 46.7 x Depth 37.6 [Height 1710 x Width 1185 x Depth 955]
HRS100-W□-20-A	452 [205]	Height 63.4 x Width 36.4 x Depth 37.6 [Height 1610 x Width 925 x Depth 955]
HRS150-W□-20-A	459 [208]	Height 63.4 x Width 36.4 x Depth 37.6 [Height 1610 x Width 925 x Depth 955]


2. Transportation by forklift

- 1) A licensed driver should drive the forklift.
- 2) The proper place to insert the tines of the forklift differs depending on the model of cooler. Check the insert position, and be sure to drive the fork in far enough for it to come out the other side.
- 3) Be careful not to bump the fork to the cover panel or piping ports.

Warning

3. Hanging transportation

- 1) Crane manipulation and slinging work should be done by an eligible person.
- 2) Do not grip the piping on the right side or the handles of the panel.
- 3) When hanging by the eye bolts, be sure to use a 4-point hanging method. For the hanging angle, use caution regarding the position of the center of gravity and hold it within 60°.

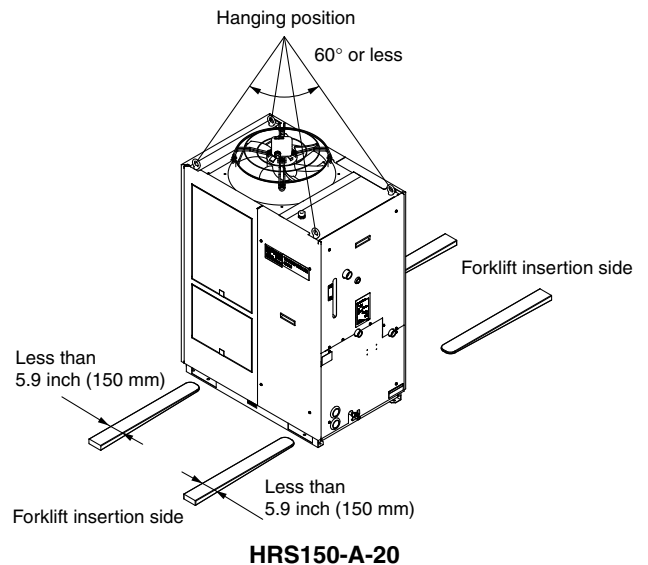

<When using option A>

4. Transporting using casters

- 1) This product is heavy and should be moved by at least two persons.
- 2) Do not grip the piping port on the right side or the handles of the panel.
- 3) When transporting using a forklift, be sure not to let it hit the casters or adjusters, and drive the fork all the way through until it comes out the other side.
- 4) Do not get across steps with casters.

Mounting/Installation

Warning

Do not place heavy objects on top of this product, or step on it.

The external panel can be deformed and danger can result.

Caution

1. Install on a rigid floor which can withstand this product's weight.
2. Secure with bolts, anchor bolts, etc.



Series HRS100/150 Specific Product Precautions 3

Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to "Handling Precautions for SMC Products" and the Operation Manual on SMC website, <http://www.smcworld.com>

Mounting/Installation


⚠ Caution

3. Refer to the Operation Manual for this product, and secure an installation space that is necessary for the maintenance and ventilation.

<Air-cooled refrigeration>

1. The air-cooled type product exhausts heat using the fan that is mounted to the product. If the product is operated with insufficient ventilation, ambient temperature may exceed 113°F (45°C), and this will affect the performance and life of the product. To prevent this ensure that suitable ventilation is available (see below).
2. For installation indoors, ventilation ports and a ventilation fan should be equipped as needed.

Required installation space for ventilation and maintenance

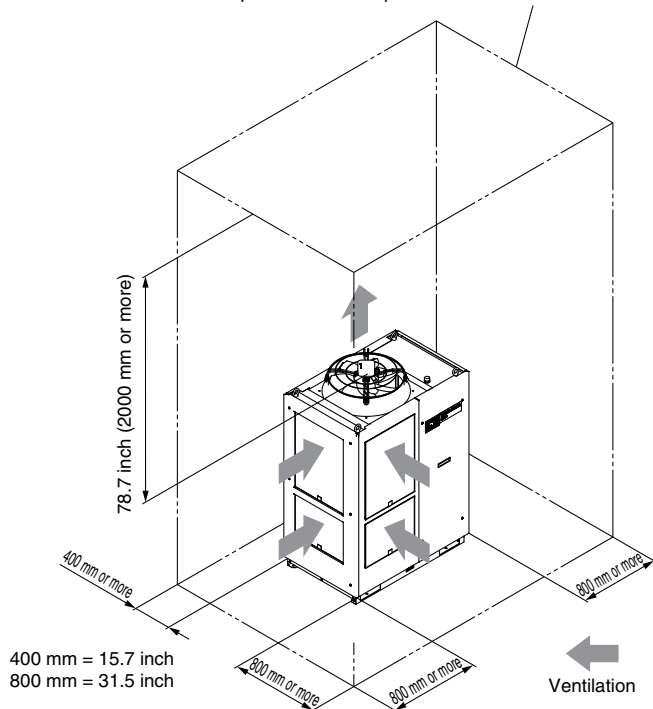

HRS150-A-20

3. If it is impossible to exhaust heat from the installation area indoors, or when the installation area is conditioned, provide a duct for heat exhaustion to the air outlet port of this product for ventilation. Do not mount the inlet of the duct (flange) directly to the air vent of the product, and keep a space larger than the diameter of the duct. Additionally, consider the resistance of the duct when making the air vent port for the duct.


<Heat radiation amount/Required ventilation rate>

Model	Heat radiation amount [kW]	Required ventilation rate [m ³ /min]	
		Differential temp. of 5.4°F [3°C] between inside and outside of installation	Differential temp. of 10.8°F [6°C] between inside and outside of installation
HRS100-A-20	Approx.	305	155
HRS150-A-20	Approx.	440	220

⚠ Caution

<Water-cooled refrigeration>

When installing the product, keep the space for maintenance as shown below.

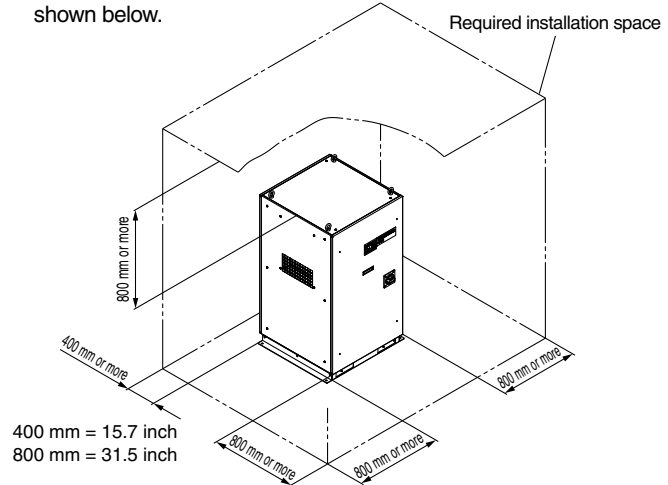

Piping

⚠ Caution

1. Regarding the circulating fluid and facility water pipings, consider carefully the suitability for temperature, circulating fluid and facility water.

If the operating performance is not sufficient, the pipings may burst during operation. Using corrosive materials such as aluminum or iron for fluid contact parts such as piping may cause clogging or leakage in the circulating fluid and facility water circuits. Provide protection against corrosion when you use the product.

2. Select the piping port size which can exceed the rated flow.

For the rated flow, refer to the pump capacity table.

3. When tightening at the drain port of this product, use a pipe wrench to clamp the connection ports.

4. Supply water pressure to the automatic fluid fill port of this product should be 29 to 73 psi (0.2 to 0.5 MPa).

This product has a built-in ball (float) tap. If you attach it to the faucet of a sink etc. it will automatically supply water to the rated fluid level of the tank (halfway between HIGH and LOW.)

If the water supply pressure is too high, the pipes may burst during use. Proceed with caution.

5. Ensure that piping is connected to the overflow port so that the circulating fluid can be exhausted to the drainage pit when the fluid level in the tank increases.

6. For the circulating fluid piping connection, install a drain pan and wastewater collection pit just in case the circulating fluid may leak.

7. This product series are constant-temperature fluid circulating machines with built-in tanks.

Do not install equipment on your system side such as pumps that forcibly return the circulating fluid to the unit. Also, if you attach an external tank that is open to the air, it may become impossible to circulate the circulating fluid. Proceed with caution.



Series HRS100/150 Specific Product Precautions 4

Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to "Handling Precautions for SMC Products" and the Operation Manual on SMC website, <http://www.smcworld.com>

Electrical Wiring


Warning

Grounding should never be connected to a water line, gas line or lightning rod.

Caution

1. Power supply and communication cables should be prepared by user.
2. Provide a stable power supply which is not affected by surge or distortion.

If the voltage increase ratio (dV/dt) at the zero cross should exceed 40 V/200 μ sec., it may result in malfunction.

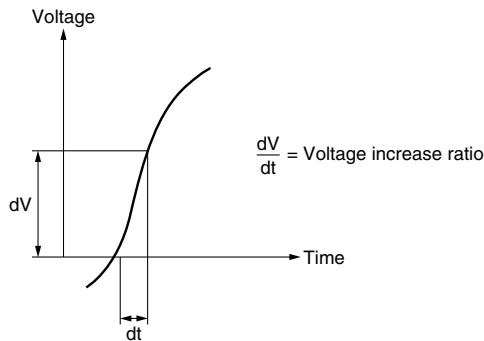


< For option B [With earth leakage breaker]>

3. This product is installed with a breaker with the following operating characteristics.


For the user's equipment (inlet side), use a breaker whose operating time is equal to or longer than the breaker of this product. If a breaker with shorter operating time is connected, the user's equipment could be cut off due to the inrush current of the motor of this product.

HRS100-A/W-20

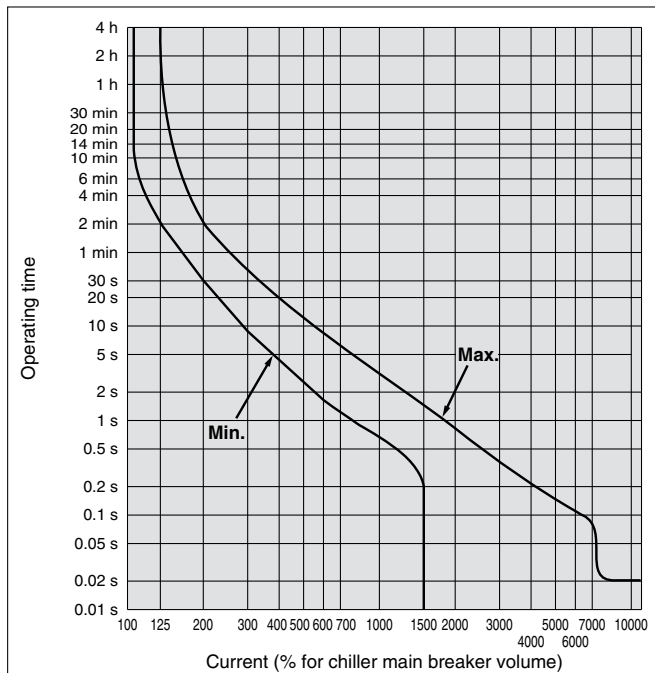

Caution

HRS150-A/W-20

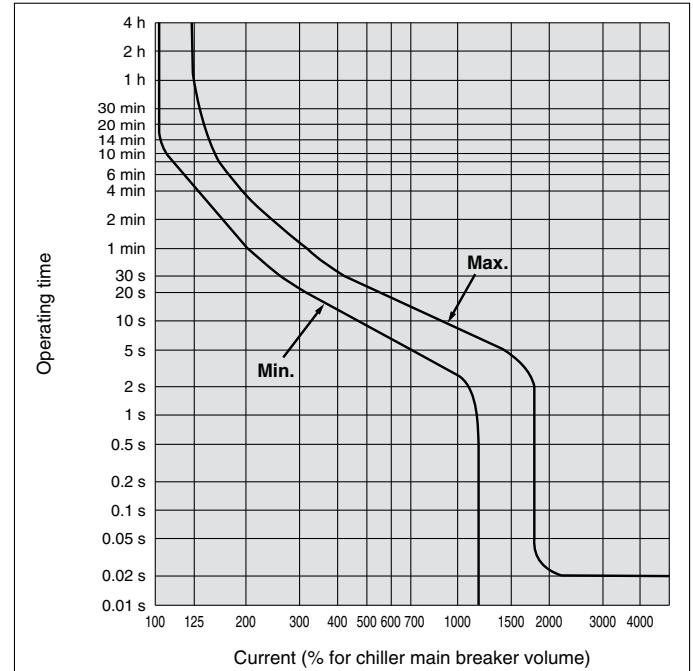



Series HRS100/150 Specific Product Precautions 5

Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to "Handling Precautions for SMC Products" and the Operation Manual on SMC website, <http://www.smcworld.com>

Circulating Fluid

⚠ Caution

1. Avoid oil or other foreign objects entering the circulating fluid.
2. When water is used as a circulating fluid, use tap water that conforms to the appropriate water quality standards. Use tap water that conforms to the standards shown below (including water used for dilution of ethylene glycol aqueous solution).

Tap Water (as Circulating Fluid) Quality Standards

The Japan Refrigeration and Air Conditioning Industry Association
JRA GL-02-1994 "Cooling water system – Circulation type – Make-up water"

	Item	Unit	Standard value	Influence	
				Corrosion	Scale generation
Standard item	pH (at 77°F [25°C])	—	6.0 to 8.0	○	○
	Electric conductivity (25°C)	[μS/cm]	100* to 300*	○	○
	Chloride ion (Cl ⁻)	[mg/L]	50 or less	○	
	Sulfuric acid ion (SO ₄ ²⁻)	[mg/L]	50 or less	○	
	Acid consumption amount (at pH4.8)	[mg/L]	50 or less		○
	Total hardness	[mg/L]	70 or less		○
	Calcium hardness (CaCO ₃)	[mg/L]	50 or less		○
Reference item	Ionic state silica (SiO ₂)	[mg/L]	30 or less		○
	Iron (Fe)	[mg/L]	0.3 or less	○	○
	Copper (Cu)	[mg/L]	0.1 or less	○	
	Sulfide ion (S ₂ ⁻)	[mg/L]	Should not be detected.	○	
	Ammonium ion (NH ₄ ⁺)	[mg/L]	0.1 or less	○	
	Residual chlorine (Cl)	[mg/L]	0.3 or less	○	
	Free carbon (CO ₂)	[mg/L]	4.0 or less	○	

* In the case of [MΩ·cm], it will be 0.003 to 0.01.

- : Factors that have an effect on corrosion or scale generation.
- Even if the water quality standards are met, complete prevention of corrosion is not guaranteed.

3. Use an ethylene glycol aqueous solution that does not contain additives such as preservatives.
4. When using ethylene glycol aqueous solution, maintain a maximum concentration of 15%.
Overly high concentrations can cause a pump overload. Low concentrations, however, can lead to freezing when circulating fluid temperature is 50°F (10°C) or lower and cause the thermo-chiller to break down.
5. When deionized water is used, the electric conductivity should be 1 μS/cm or higher (Electric resistivity: 1 MW·cm or lower).

Facility Water Supply

⚠ Warning

<Water-cooled refrigeration>

1. The water-cooled refrigeration type thermo-chiller radiates heat to the facility water.
Prepare the facility water system that satisfies the heat radiation and the facility water specifications below.

■ Required facility water system

<Heat radiation amount/Facility water specifications>

Model	Heat radiation	Facility water specifications
HRS100-W-20	Approx. 19	Refer to "Facility water system" in the specifications on page 8.
HRS150-W-20	Approx. 28	

2. When using tap water as facility water, use water that conforms to the appropriate water quality standards. Use water that conforms to the standards shown below.

Tap Water (as Facility Water) Quality Standards

The Japan Refrigeration and Air Conditioning Industry Association
JRA GL-02-1994 "Cooling water system – Circulation type – Make-up water"

	Item	Unit	Standard value	Influence	
				Corrosion	Scale generation
Standard item	pH (at 77°F [25°C])	—	6.5 to 8.2	○	○
	Electric conductivity (25°C)	[μS/cm]	100* to 800*	○	○
	Chloride ion (Cl ⁻)	[mg/L]	200 or less	○	
	Sulfuric acid ion (SO ₄ ²⁻)	[mg/L]	200 or less	○	
	Acid consumption amount (at pH4.8)	[mg/L]	100 or less		○
	Total hardness	[mg/L]	200 or less		○
	Calcium hardness (CaCO ₃)	[mg/L]	150 or less		○
Reference item	Ionic state silica (SiO ₂)	[mg/L]	50 or less		○
	Iron (Fe)	[mg/L]	1.0 or less	○	○
	Copper (Cu)	[mg/L]	0.3 or less	○	
	Sulfide ion (S ₂ ⁻)	[mg/L]	Should not be detected.	○	
	Ammonium ion (NH ₄ ⁺)	[mg/L]	1.0 or less	○	
	Residual chlorine (Cl)	[mg/L]	0.3 or less	○	
	Free carbon (CO ₂)	[mg/L]	4.0 or less	○	

* In the case of [MΩ·cm], it will be 0.001 to 0.01.

- : Factors that have an effect on corrosion or scale generation.
- Even if the water quality standards are met, complete prevention of corrosion is not guaranteed.

3. Set the supply pressure between 44 to 73 psi (0.3 to 0.5 MPa). Ensure a pressure difference at the facility water inlet/outlet of 44 psi (0.3 MPa) or more.

If the supply pressure is high, it will cause water leakage. If the supply pressure and pressure difference at the facility water inlet/outlet is low, it will cause an insufficient flow rate of the facility water, and poor temperature control.



Series HRS100/150

Specific Product Precautions 6

Be sure to read this before handling. Refer to the back cover for Safety Instructions. For Temperature Control Equipment Precautions, refer to “Handling Precautions for SMC Products” and the Operation Manual on SMC website, <http://www.smcworld.com>

Operation

Warning

1. Confirmation before operation

- 1) The fluid level of a tank should be within the specified range of “HIGH” and “LOW”.

When exceeding the specified level, the circulating fluid will overflow.

- 2) Remove the air.

Conduct a trial operation, looking at the fluid level.

Since the fluid level will go down when the air is removed from the user's piping system, supply water once again when the fluid level is reduced. When there is no reduction in the fluid level, the job of removing the air is completed.

Pump can be operated independently.

2. Confirmation during operation

- Check the circulating fluid temperature.

The operating temperature range of the circulating fluid is between 41 and 95°F (5 and 35°C).

When the amount of heat generated from the user's equipment is greater than the product's capability, the circulating fluid temperature may exceed this range. Use caution regarding this matter.

3. Emergency stop method

- When an abnormality is confirmed, stop the machine immediately. After the machine has stopped, make sure to turn off the breaker of the user's equipment (on the upstream side).

Operation Restart Time

Caution

Wait five minutes or more before restarting operation after it has been stopped. If the operation is restarted within five minutes, the protection circuit may activate and the operation may not start properly.

Protection Circuit

Caution

If operating in the below conditions, the protection circuit will activate and an operation may not be performed or will stop.

- Power supply voltage is not within the rated voltage range of $\pm 10\%$.
- In case the water level inside the tank is reduced abnormally.
- Circulating fluid temperature is too high.
- Compared to the cooling capacity, the heat generation amount of the user's equipment is too high.
- Ambient temperature is over 113°F (45°C).
- Ventilation hole is clogged with dust or dirt.

Maintenance

Caution

<Periodical inspection every one month>

Clean the ventilation hole.

If the dustproof filter of water-cooled type product becomes clogged with dust or debris, a decline in cooling performance can result.

In order to avoid deforming or damaging the dustproof filter, clean it with a long-haired brush or air gun.

<Periodical inspection every three months>

Inspect the circulating fluid.

1. When using tap water or deionized water

- Replacement of circulating fluid

Failure to replace the circulating fluid can lead to the development of bacteria or algae. Replace it regularly depending on your usage conditions.

2. When using ethylene glycol aqueous solution

Use a concentration meter to confirm that the concentration does not exceed 15%.

Dilute or add as needed to adjust the concentration.

<Periodical inspection during the winter season>

1. Make water-removal arrangements beforehand.


If there is a risk of the circulating fluid and facility water freezing when the product is stopped, release the circulating fluid and facility water in advance.


2. Consult a professional.


This product has an “anti-freezing function”, “warming-up function”, and “anti-snow coverage function”. Read the Operation Manual carefully, and if any additional anti-freezing function (e.g. tape heater) is needed, ask for it from the vendor.

Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “**Caution**,” “**Warning**” or “**Danger**.” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)*1), and other safety regulations.

 **Caution:** **Caution** indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

 **Warning:** **Warning** indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.

 **Danger:** **Danger** indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.

*1) ISO 4414: Pneumatic fluid power – General rules relating to systems.
ISO 4413: Hydraulic fluid power – General rules relating to systems.
IEC 60204-1: Safety of machinery – Electrical equipment of machines.
(Part 1: General requirements)
ISO 10218-1: Manipulating industrial robots – Safety.
etc.

Warning

1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

4. Contact SMC beforehand and take special consideration of safety measures if the product is to be used in any of the following conditions.

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Installation on equipment in conjunction with atomic energy, railways, air navigation, space, shipping, vehicles, military, medical treatment, combustion and recreation, or equipment in contact with food and beverages, emergency stop circuits, clutch and brake circuits in press applications, safety equipment or other applications unsuitable for the standard specifications described in the product catalog.
3. An application which could have negative effects on people, property, or animals requiring special safety analysis.
4. Use in an interlock circuit, which requires the provision of double interlock for possible failure by using a mechanical protective function, and periodical checks to confirm proper operation.

Caution

1. The product is provided for use in manufacturing industries.

The product herein described is basically provided for peaceful use in manufacturing industries.
If considering using the product in other industries, consult SMC beforehand and exchange specifications or a contract if necessary.
If anything is unclear, contact your nearest sales branch.

Limited warranty and Disclaimer/ Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”.

Read and accept them before using the product.

Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first.*2)
Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.
This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalog for the particular products.

*2) **Vacuum pads are excluded from this 1 year warranty.**

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.
Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.


Compliance Requirements

1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

Caution

SMC products are not intended for use as instruments for legal metrology.

Measurement instruments that SMC manufactures or sells have not been qualified by type approval tests relevant to the metrology (measurement) laws of each country. Therefore, SMC products cannot be used for business or certification ordained by the metrology (measurement) laws of each country.

 **Safety Instructions** Be sure to read “Handling Precautions for SMC Products” (M-E03-3) before using.

SMC Corporation of America
10100 SMC Blvd., Noblesville, IN 46060
www.smcusa.com

SMC Pneumatics (Canada) Ltd.
www.smcpcanada.com

(800) SMC.SMC1 (762-7621)
e-mail: sales@smcusa.com
International inquiries: www.smcworld.com

